

NOTES(Cont)


- 25. CONTRACTOR TO TAKE MEASURES TO PROTECT HIS OPERATIVES WITH RESPECT TO THE PRESENCE OF GAS IN SEWER TRENCHES AND MANHOLES THROUGH THE USE OF GAS MONITORING EQUIPMENT AND BREATHING APPARATUS AS REQUIRED.
 - 26. CONTRACTOR TO APPLY FOR SEWER PERMITS AND ROAD OPENING PERMITS AS NECESSARY FROM THE APPROPRIATE AUTHORITIES, PRIOR TO COMMENCING WORKS.
- HEALTH & SAFETY**
- CONTRACTOR SHOULD BE AWARE OF GENERAL CONSTRUCTION RISKS TO PREVENT SLIPS, TRIPS AND FALLS AND TAKE NECESSARY PRECAUTIONS WITHOUT SPECIAL INSTRUCTION.
 - CONTRACTOR TO PROVIDE TRENCH SUPPORTS AS APPROPRIATE AND ENSURE THAT PLANT REMAINS A SAFE DISTANCE FROM TRENCHES PRIOR TO INSTALLING DRAINAGE.
 - THE TIME THAT EXCAVATIONS ARE OPEN ON SITE SHOULD BE KEPT TO A MINIMUM AND ALL TRENCHES SHOULD BE SURROUNDED BY A BARRIER.
 - CONNECTIONS TO EXISTING SEWERS TO BE MADE BY NML APPROVED CONTRACTOR ONLY.
 - CONTRACTOR TO MAKE OPERATIVES AWARE OF ASSOCIATED DANGERS TO HEALTH SUCH AS LEPTOSPIROSIS (WELLS DISEASE) AND RECOMMENDED PRECAUTIONS, ADEQUATE WELFARE FACILITIES AND PROTECTIVE CLOTHING TO BE PROVIDED AS REQUIRED.
 - UNFINISHED MANHOLES MUST BE COVERED WITH LOAD BEARING MATERIALS AND SURROUNDED WITH BARRIER.
- PIPER & CABLES**
- SERVE RECORDS TO BE REFERRED TO PRIOR TO WORK COMMENCING. CONTRACTOR TO PROCEED WITH CAUTION AND SERVICES TO BE LOCATED BY HAND DIG AND PROTECTED ACCORDINGLY.
 - CONTRACTOR TO ENSURE RELEVANT MEASURES ARE TAKEN TO KEEP PLANT AND PEOPLE A SAFE DISTANCE FROM STEEP SLOPES DURING THE WORKS.
 - CONTRACTOR TO ENSURE THAT PROCEDURES ARE IN PLACE TO KEEP PEOPLE A SAFE DISTANCE FROM WORKING PLANT WHERE NECESSARY.
 - CONTRACTOR TO REFER TO GROUND INVESTIGATION REPORT FOR CONTAMINATION TESTS AND TO PROVIDE ADEQUATE WELFARE FACILITIES AND PROTECTIVE CLOTHING AS REQUIRED.

Only PDF/DWF Issues of this drawing are controlled. All other formats (eg. DWG AutoCAD FILES) are UN-controlled and are used at your own risk.


This drawing is copyright © It is sent to you in confidence and must not be copied, used or disclosed to any third parties without 3E permission. It remains the property of 3E and must be returned on request.

Contractors should refer to the residual risks contained in the CDM Pre Construction Information before carrying out any site operations and should not issue parts of this drawing without including the CDM notes and references. This information will include details of the SIGNIFICANT RISKS which 3E have considered beyond that which a competent contractor should be aware.

- NOTES**
- ALL DRAINAGE WORKS SHALL BE CARRIED OUT IN ACCORDANCE WITH THE WATER SERVICES ASSOCIATION "SEWERS FOR ADOPTION" - 7TH EDITION AND ADOPTING WATER AUTHORITY/SEWERAGE AGENCY REQUIREMENTS AND SPECIFICATIONS.
 - ALL PRIVATE DRAINAGE WORKS SHALL BE CARRIED OUT IN ACCORDANCE WITH BUILDING REGULATIONS 2002 EDITION.
 - CONTRACTOR TO ESTABLISH POSITION SIZE AND DEPTH OF ALL EXISTING SEWERS AND SERVICES PRIOR TO COMMENCEMENT ON SITE.
 - THE CONTRACTOR SHALL ALLOW FOR THE PROTECTION, TEMPORARY AND PERMANENT SUPPORT, AND TEMPORARY AND PERMANENT DIVERSION WORKS, AS NECESSARY TO ALL EXISTING SERVICES.
 - THE CONTRACTOR SHALL ALLOW FOR ALL TRAFFIC MANAGEMENT IN CONNECTION WITH ROAD AND SEWER WORKS.
 - THE CONTRACTOR SHALL ALLOW FOR KEEPING SEWER TRENCHES AND EXCAVATIONS AS DRY AS PRACTICABLE BY PUMPING FROM TEMPORARY SUMPS AND DEMATERING AS APPROPRIATE. THE FRONT AND METHOD OF DISCHARGE TO BE AGREED WITH THE DRAINAGE AUTHORITY.
 - PIPES UP TO AND INCLUDING 300mm# TO BE UNPLASTICISED PVC. PIPES 375mm# AND GREATER TO BE CONCRETE CLASS H.
 - ALL PIPEWORK TO BE 100mm DIAMETER UNLESS NOTED OTHERWISE.
 - INSITU AND PRECAST CONCRETE UNITS SHALL HAVE SULPHATE RESISTING PORTLAND CEMENT TO BS 4027, UNLESS AGREED OTHERWISE WITH THE ADOPTING AUTHORITY.
 - PRECAST CONCRETE PRODUCTS SHALL COMPLY WITH THE RELEVANT PROVISIONS OF BS 5911 AND BE KITEMARKED. CONCRETE PIPES TO BE CLASS H UNLESS NOTED OTHERWISE.
 - MANHOLE COVERS AND FRAMES SHALL COMPLY WITH THE RELEVANT PROVISIONS OF BS EN124, HAVE MINIMUM 675 x 675 CLEAR OPENINGS WITH 150 DEEP FRAMES UNLESS OTHERWISE SPECIFIED. MANHOLE COVERS AND FRAMES TO BE OF A NON-ROCKING DESIGN WITHOUT CUSHION INSERTS AND BE KITEMARKED. LOAD CLASS D400 IN VEHICULAR TRAFFICKED AREAS AND LOAD CLASS B125 IN FOOTWAYS AND PEDESTRIAN AREAS.
 - GULLY GRATES AND FRAMES SHALL COMPLY WITH THE RELEVANT PROVISIONS OF BS EN124 AND BE OF A NON-ROCKING DESIGN WITH CAPTIVE HINGE ACCESS AND BE KITEMARKED. LOAD CLASS D400 FOR ROADS REGULARLY CARRYING FAST MOVING HEAVY VEHICLES. CLASS C250 TO BE USED IN LESSER TRAFFICKED AREAS eg. ESTATE ROADS, CUL-DE-SACS, RESIDENTIAL CAR PARKING AREAS ETC.
 - CLASS 2 BEDDING DETAIL SHALL BE PROVIDED WHERE COVER TO THE PIPE BARREL IS LESS THAN 1.2M IN VEHICULAR TRAFFICKED AREAS AND 0.9M ELSEWHERE, TO ALL ROAD GULLY CONNECTIONS AND WITHIN AREAS OF DEEP ROOTING VEGETATION.
 - WHERE CLASS 2 TRENCH BEDDING DETAIL IS USED, THE CONCRETE BED AND SURROUND SHALL BE DISCONTINUED AT EACH PIPE JOINT OVER THE FULL CROSS SECTION BY MEANS OF A SHAPED COMPRESSIBLE FILLER.
 - SELECTED BACKFILL MATERIAL SHALL CONSIST OF UNIFORM MATERIAL FREE FROM STONES LARGER THAN 40mm, CLAY LUMPS LARGER THAN 75mm, TREE ROOTS, ORGANIC MATTER AND FROZEN SOIL. SELECTED BACKFILL MATERIAL SHALL BE PLACED IN LAYER NOT EXCEEDING 225mm, EACH LAYER COMPACTED TO FORM A STABLE TRENCH BACKFILL.
 - GENERAL BACKFILL MATERIAL TO BE FREE FROM STONES LARGER THAN 40mm. GENERAL BACKFILL MATERIAL IS TO BE PLACED IN LAYERS NOT EXCEEDING 150mm THICKNESS AND EACH LAYER COMPACTED BY HAND. NO MECHANICAL COMPACTION OF FILL MATERIAL SHALL BE PERMITTED WITHIN 300mm ABOVE THE CROWN/BARREL OF THE PIPE.
 - BACKFILLING AND REINSTATEMENT TO TRENCHES IN PUBLIC HIGHWAYS SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS AND SPECIFICATIONS OF THE ADOPTING AUTHORITY, OR, IN THE ABSENCE OF SUCH, IN ACCORDANCE WITH THE REQUIREMENTS OF THE "STREET WORKS REGULATIONS 1992" AND RELEVANT PROVISIONS OF H.A.U.C. "SPECIFICATION FOR THE REINSTATEMENT OF OPENINGS IN HIGHWAYS" JUNE 1992, BOTH UNDER SECTION 71 OF THE NEW ROADS AND STREET WORKS ACT 1991.
 - BACKFILL TO DRAINAGE TRENCHES IN HARD PAVED AREAS SHALL BE G.S.B. TYPE 1.
 - ALL ROAD GULLIES ARE TO BE TRAPPED GULLIES.
 - ALL GULLY LEADS TO BE 150mm DIAMETER.
 - ALL REDUNDANT EXISTING DRAINAGE TO BE GRUBBED UP OR GROUTED, ANY EXISTING LIVE DRAINAGE SHOULD BE REPORTED TO THE ENGINEER AND RECONNECTED.
 - ALL ROAD GULLIES & LEADS TO BE CLEARED OF DEBRIS UPON COMPLETION OF WORKS.
 - ANY EXISTING DRAINAGE WHICH BECOMES UNDER TRAFFICKED AREAS IN THE NEW SCHEME SHOULD BE SUBJECT TO THE FOLLOWING REMEDIALS/REVISIONS, WHERE DEPTH OF COVER IS LESS THAN 1000mm, THE EXISTING MANHOLE SHALL BE EXPOSED & SURROUNDED WITH 150MM CONCRETE AS CLASS "Z" BEDDING, WHERE THE EXISTING MANHOLE COVER & FRAME IS NOT AS MANHOLE DETAIL A OR B, OR TO BS497 GRADE A, OR EN124 CLASS D, THEN IT SHOULD BE CHANGED FOR SUCH.
 - THE CONTRACTOR MUST ENSURE THAT ANY OF THE EXISTING DRAINAGE WHICH IS LIVE IS KEPT CLEAR OF DEBRIS AND SHOULD ALLOW FOR JETTING THROUGH THE NEW & EXISTING DRAINAGE UPON COMPLETION.

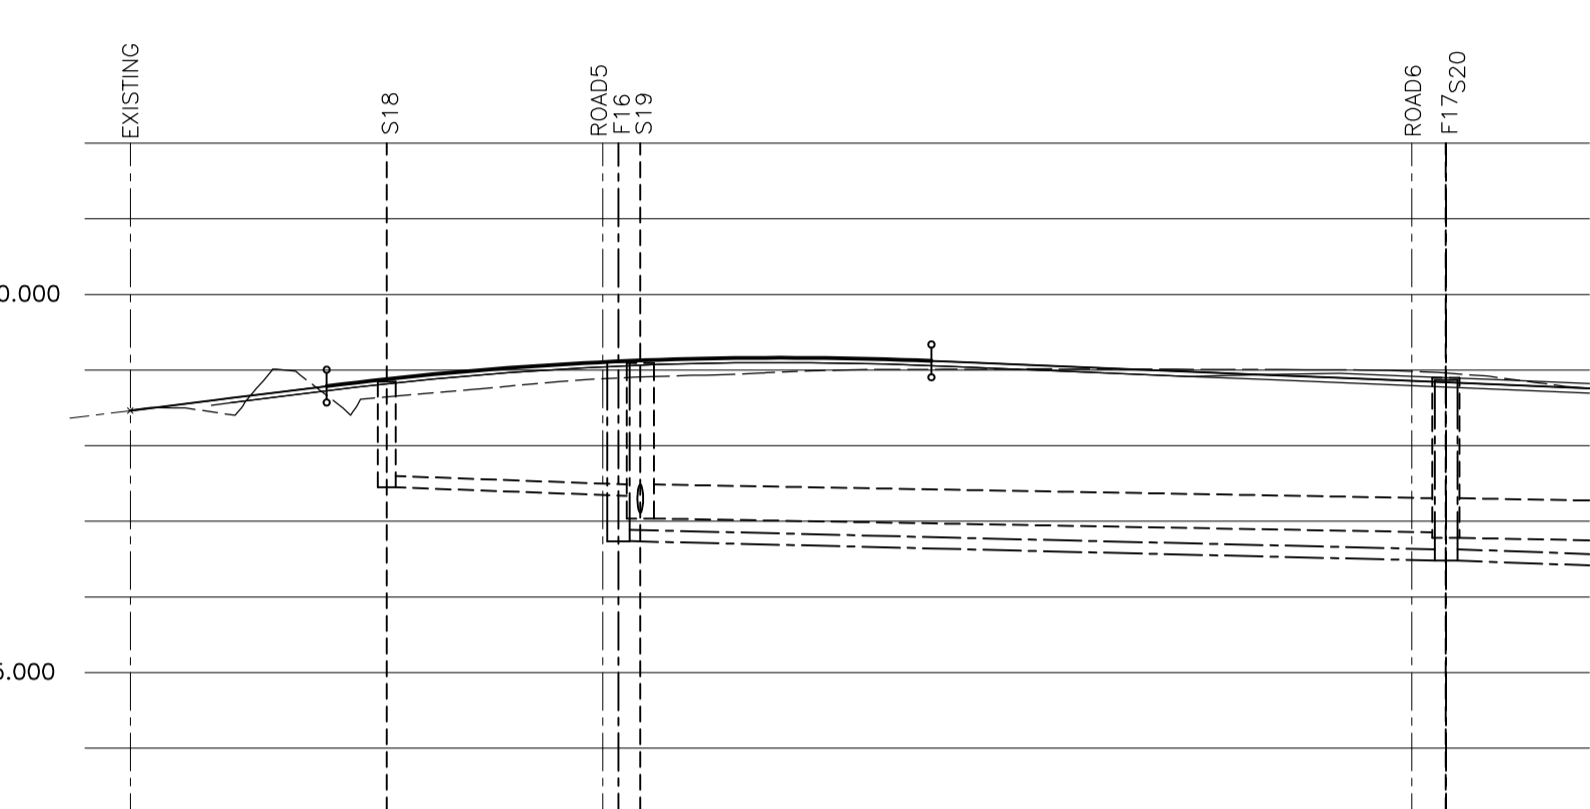

ROAD4 DATUM 3.000	
CHAINAGE	0.000 5.354 10.000 15.000 20.000 25.000 30.000 35.000 40.000 45.000 50.000 55.000 60.000 65.000 70.000 75.000 80.000 85.000 90.000 95.000 98.848
EXISTING GROUND LEVEL	8.472 8.588 8.713 8.788 8.836 8.943 9.028 9.093 9.136 9.159 9.163 9.161 9.142 9.009 8.987 9.104 9.063 9.016 9.021 8.979 8.910 8.838 8.896 8.854 8.813 8.771 8.759
ALIGNMENT LEVEL	8.463 8.588 8.713 8.788 8.836 8.943 9.028 9.093 9.136 9.159 9.163 9.161 9.142 9.009 8.987 9.104 9.063 9.016 9.021 8.979 8.910 8.838 8.896 8.854 8.813 8.771 8.759
VERTICAL ALIGNMENT	G = 2.500% 1: 40.0 L = 40.000 KF = -12.0 G = -0.833% 1: -120.0
HORIZONTAL ALIGNMENT	R = 10.500
LEFT HAND CHANNEL	8.535 8.567 8.651 8.774 8.880 8.966 9.030 9.074 9.074 9.097 9.099 9.080 9.042 9.000 8.959 8.917 8.875 8.834 8.792 8.750 8.709 8.686 8.621
RIGHT HAND CHANNEL	8.567 8.651 8.774 8.880 8.966 9.030 9.074 9.074 9.097 9.099 9.080 9.042 9.000 8.959 8.917 8.875 8.834 8.792 8.750 8.709 8.686 8.621
STORMWATER COVER LEVEL	8.849 9.084 9.037
STORMWATER INVERT	7.449 7.337 7.037
STORMWATER DETAILS	Pipe 5.000 Dia 150 Circular CLAY 1 in 150 Pipe 1.009 Dia 450 Circular CONC 1 in 301 Pipe 1.010 Dia 525 Circular CONC 1 in 352
STORMWATER LENGTHS	16.768 54.707 13.711
FOULWATER COVER LEVEL	9.110
FOULWATER INVERT	6.737
FOULWATER DETAILS	Pipe 1.007 Dia 150 Circular CLAY 1 in 214 Pipe 1.008 Dia 150 Circular CLAY 1 in 149
FOULWATER LENGTHS	54.952 13.152

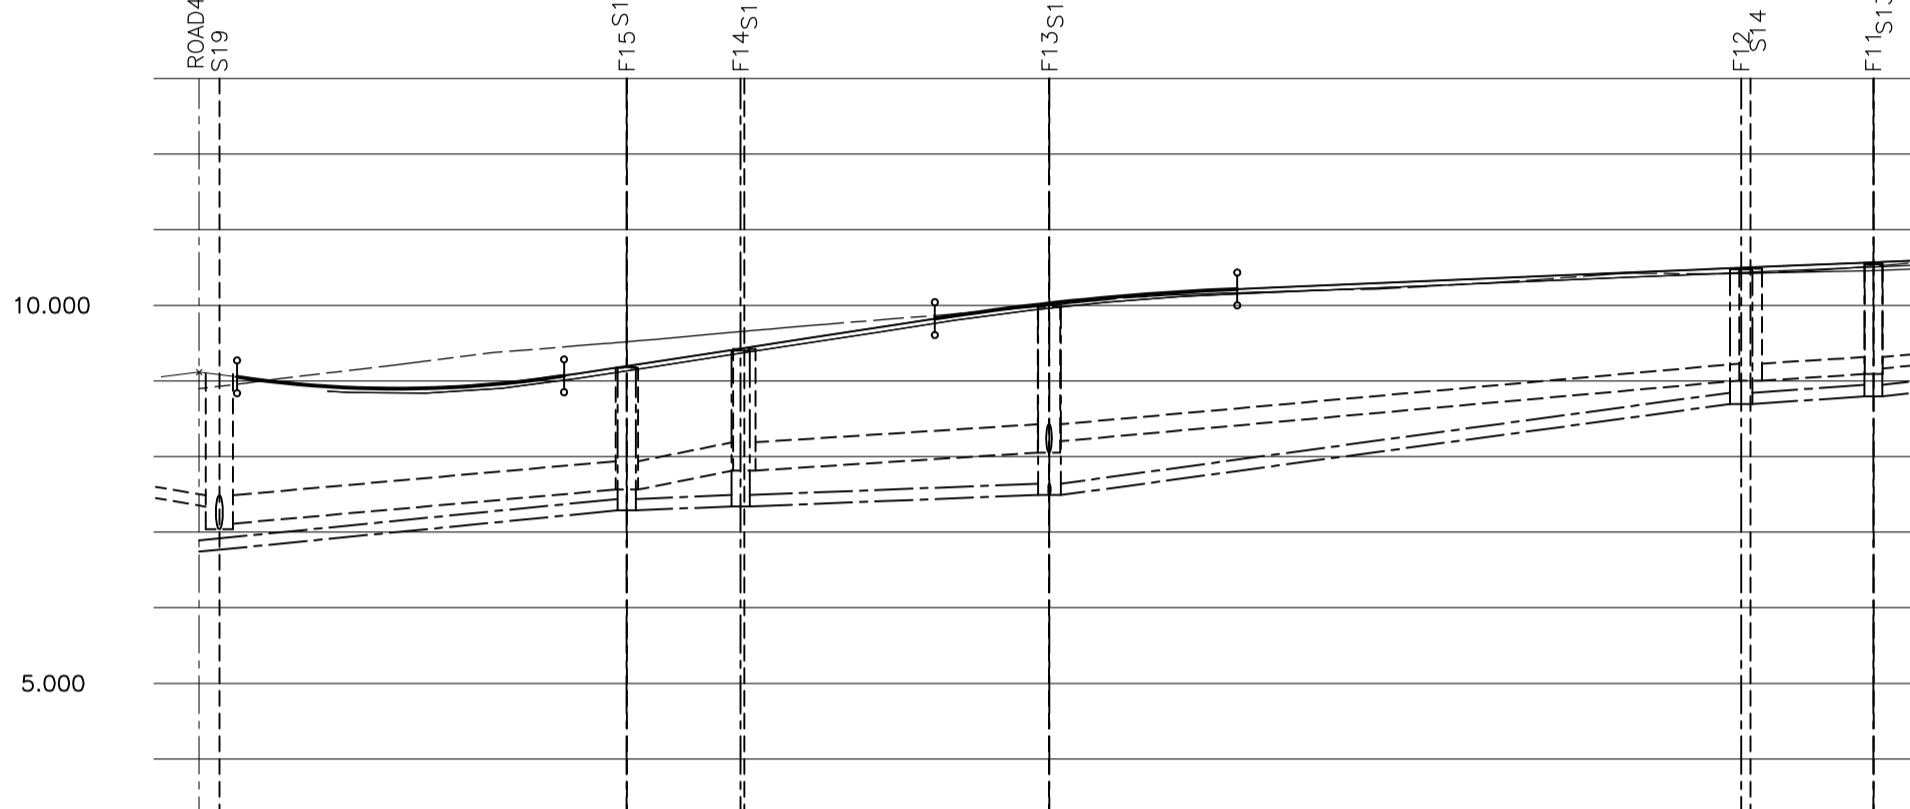

ROAD5 DATUM 3.000	
CHAINAGE	0.000 2.336 5.000 8.500 13.000 15.000 20.000 24.131 26.820 28.288 30.000 32.471 35.844 39.814 40.000 45.000 48.656 49.397 55.000 59.250 62.749 65.000 68.656 70.000 75.000 80.000 85.000 90.000 95.000 99.235 103.000 105.000 107.416 109.000 115.000 121.211
EXISTING GROUND LEVEL	8.896 8.954 8.999 8.911 8.897 8.902 8.964 9.067 9.094 9.248 9.402 9.457 9.725 9.711 9.823 9.864 9.896 10.101 10.177 10.216 10.227 10.269 10.311 10.236 10.353 10.395 10.360 10.437 10.479 10.415 10.521 10.563 10.505 10.346 10.605 10.615
ALIGNMENT LEVEL	8.896 8.954 8.999 8.911 8.897 8.902 8.964 9.067 9.094 9.248 9.402 9.457 9.725 9.711 9.823 9.864 9.896 10.101 10.177 10.216 10.227 10.269 10.311 10.236 10.353 10.395 10.360 10.437 10.479 10.415 10.521 10.563 10.505 10.346 10.605 10.615
VERTICAL ALIGNMENT	KF = 3.58266 L = 21.631 G = 3.082% 1: 32.4 L = 20.000 KF = -8.91805 G = 0.840% 1: 119.1
HORIZONTAL ALIGNMENT	R = 12.500 R = 12.500 R = 8.500 R = 10.300
LEFT HAND CHANNEL	8.864 8.848 8.840 8.901 9.032 9.186 9.340 9.494 9.648 9.801 9.934 10.038 10.115 10.164 10.206 10.248 10.290 10.332 10.374 10.410 10.416 10.458 10.454 10.500 10.456 10.542 10.592
RIGHT HAND CHANNEL	8.864 8.848 8.840 8.901 9.032 9.186 9.340 9.494 9.648 9.801 9.934 10.038 10.115 10.164 10.206 10.248 10.290 10.332 10.374 10.410 10.416 10.458 10.454 10.500 10.456 10.542 10.592
STORMWATER COVER LEVEL	9.094 9.173 9.424 9.976
STORMWATER INVERT	7.113 7.563 7.815 8.202
STORMWATER DETAILS	Pipe 1.008 Dia 375 Circular CONC 1 in 60 Pipe 1.007 Dia 375 Circular CONC 1 in 30 Pipe 1.006 Dia 375 Circular CONC 1 in 90 Pipe 4.002 Dia 225 Circular CLAY 1 in 59 Pipe 4.001 Dia 150 Circular CLAY 1 in 60
STORMWATER LENGTHS	26.844 7.573 21.373 47.717 8.637 25.846
FOULWATER COVER LEVEL	9.180 9.400 10.008
FOULWATER INVERT	7.289 7.289 7.340 7.340 7.491 7.491
FOULWATER DETAILS	Pipe 1.006 Dia 150 Circular CLAY 1 in 52 Pipe 1.005 Dia 150 Circular CLAY 1 in 149 Pipe 1.004 Dia 150 Circular CLAY 1 in 150 Pipe 4.002 Dia 150 Circular CLAY 1 in 40 Pipe 4.001 Dia 150 Circular CLAY 1 in 78
FOULWATER LENGTHS	28.571 7.595 22.695 48.148 7.935 23.963

DO NOT SCALE.

South Tyneside Council
Planning Group
Received 04/04/13
ST/008/13/FUL

19/02/13 DRAINAGE AMENDED	MP	P3
15/02/13 DRAINAGE ADDED	MP	P3
18/07/13 PRELIMINARY ISSUE	SH	P1
Date	Revisions	Drawn Rev.

first floor
block c
holland park
holland drive
newcastle upon tyne
NE2 4LD

1 0191 230 2993
f 0191 230 3677
www.3econsl.com

Client: **KEEPMOAT HOMES**

Project: **TRINITY SOUTH SOUTH SHIELDS**

Title: **PROPOSED ROAD LONGITUDINAL SECTIONS SHEET 2**

Scale: H1:500 V1:100	Drawn: SH	Checked: MP	Date: JAN 2013
----------------------	-----------	-------------	----------------

Drawing Status: **TENDER**

Job No. 11547	Drawing No. C0005	Revision P3
---------------	-------------------	-------------