



Existing Rear Elevation 1:50

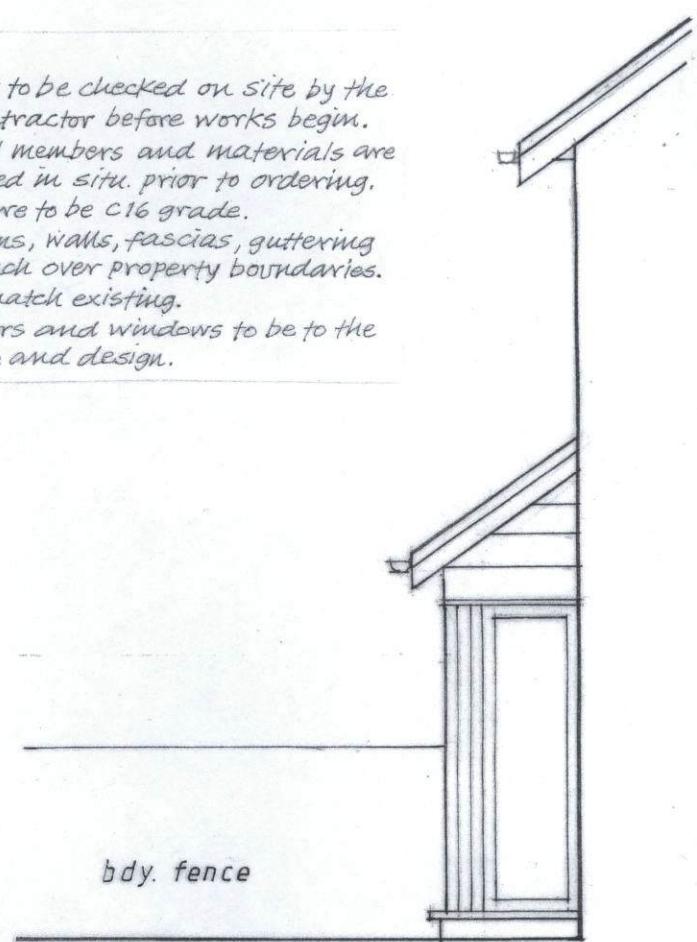

Existing Side View 1:50

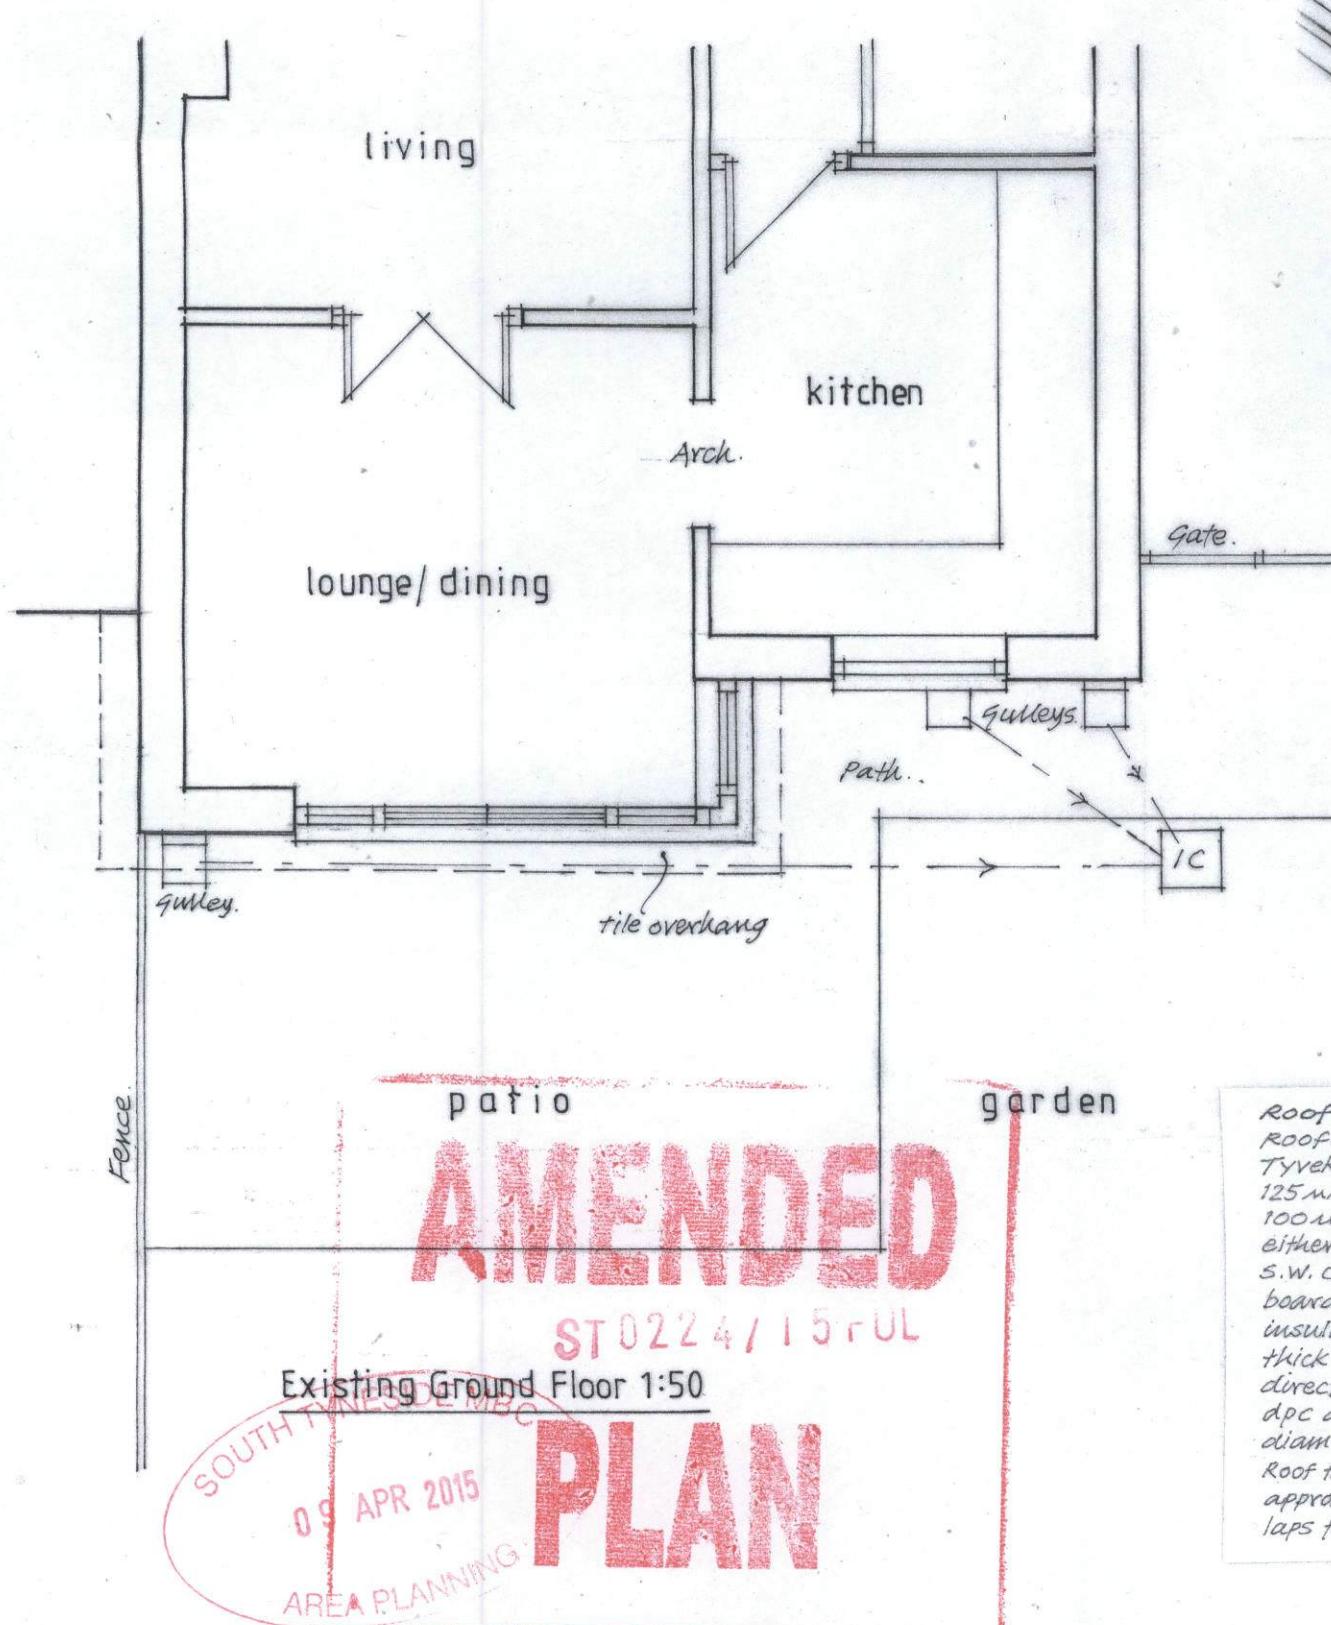

Existing Ground Floor 1:50

09 APR 2015

PLAN



Existing Side View 1:50

**Roof.**  
Roofing tiles on 50mm x 25mm S.W. tile battens. Tyvek 2001B Pro. or other approved breather felt. 125mm x 50mm S.W. rafters at 400mm c/c's. 100mm x 50mm S.W. wall plate. (Double up rafters either side of Velux Roof Windows). 150mm x 50mm S.W. ceiling joists @ 400mm c/c's. 12.5mm plasterboard and skim to ceiling. Provide 150mm thick insulation quilt between ceiling joists and 150mm thick over ceiling joists. (Layers laid in opposite directions). 150mm Code 4 lead upstand, stepped dpc at abutments. UPVC fascia and soffit. 100mm diam. upvc guttering and 62mm diam. r.w. pipe. Roof tiling to be suitable for the proposed pitch (16° approx). and manufacturers max. and min. tile laps to be observed.