




SOUTH TOWN COUNCIL  
 - 9 DEC 2015  
 AREA PLANNING



NWL Responsibility		Private/Non NWL		Proposed		Annotations		Symbols							
Combined Foul	Red solid line	Combined Foul	Green dashed line	Combined Foul	Pink dashed line	Direction of flow	Arrow	Chambers	Black square	Capped End	Black square with dot	Unknown End	Circle with question mark	Lamp Hole	Black square
Surface	Blue dashed line	Surface	Green dashed line	Surface	Pink dashed line	Backdrop	Black circle	Inlet/Outlet	Black rectangle	Balancing Pond	Black rectangle with dot	Attribute Change	Black line with dot	Manhole	Black circle with dot
Treated Eff	Blue solid line	Trade Eff	Yellow solid line	Surface	Pink dashed line	Abandoned	Black triangle	Treatment Works	Black rectangle with 'T'	Termination Node	Black triangle	Air Valve	Black diamond	Flushing Eye	Black square with dot
Untreated Eff	Red solid line	Watercourse	Blue dashed line	Surface	Pink dashed line	Rising Man	Black triangle	Pumping Station	Black triangle with dot	Flooding Eye	Black square with dot	Property Connection	Black circle with 'P'		
Overflow	Green solid line														

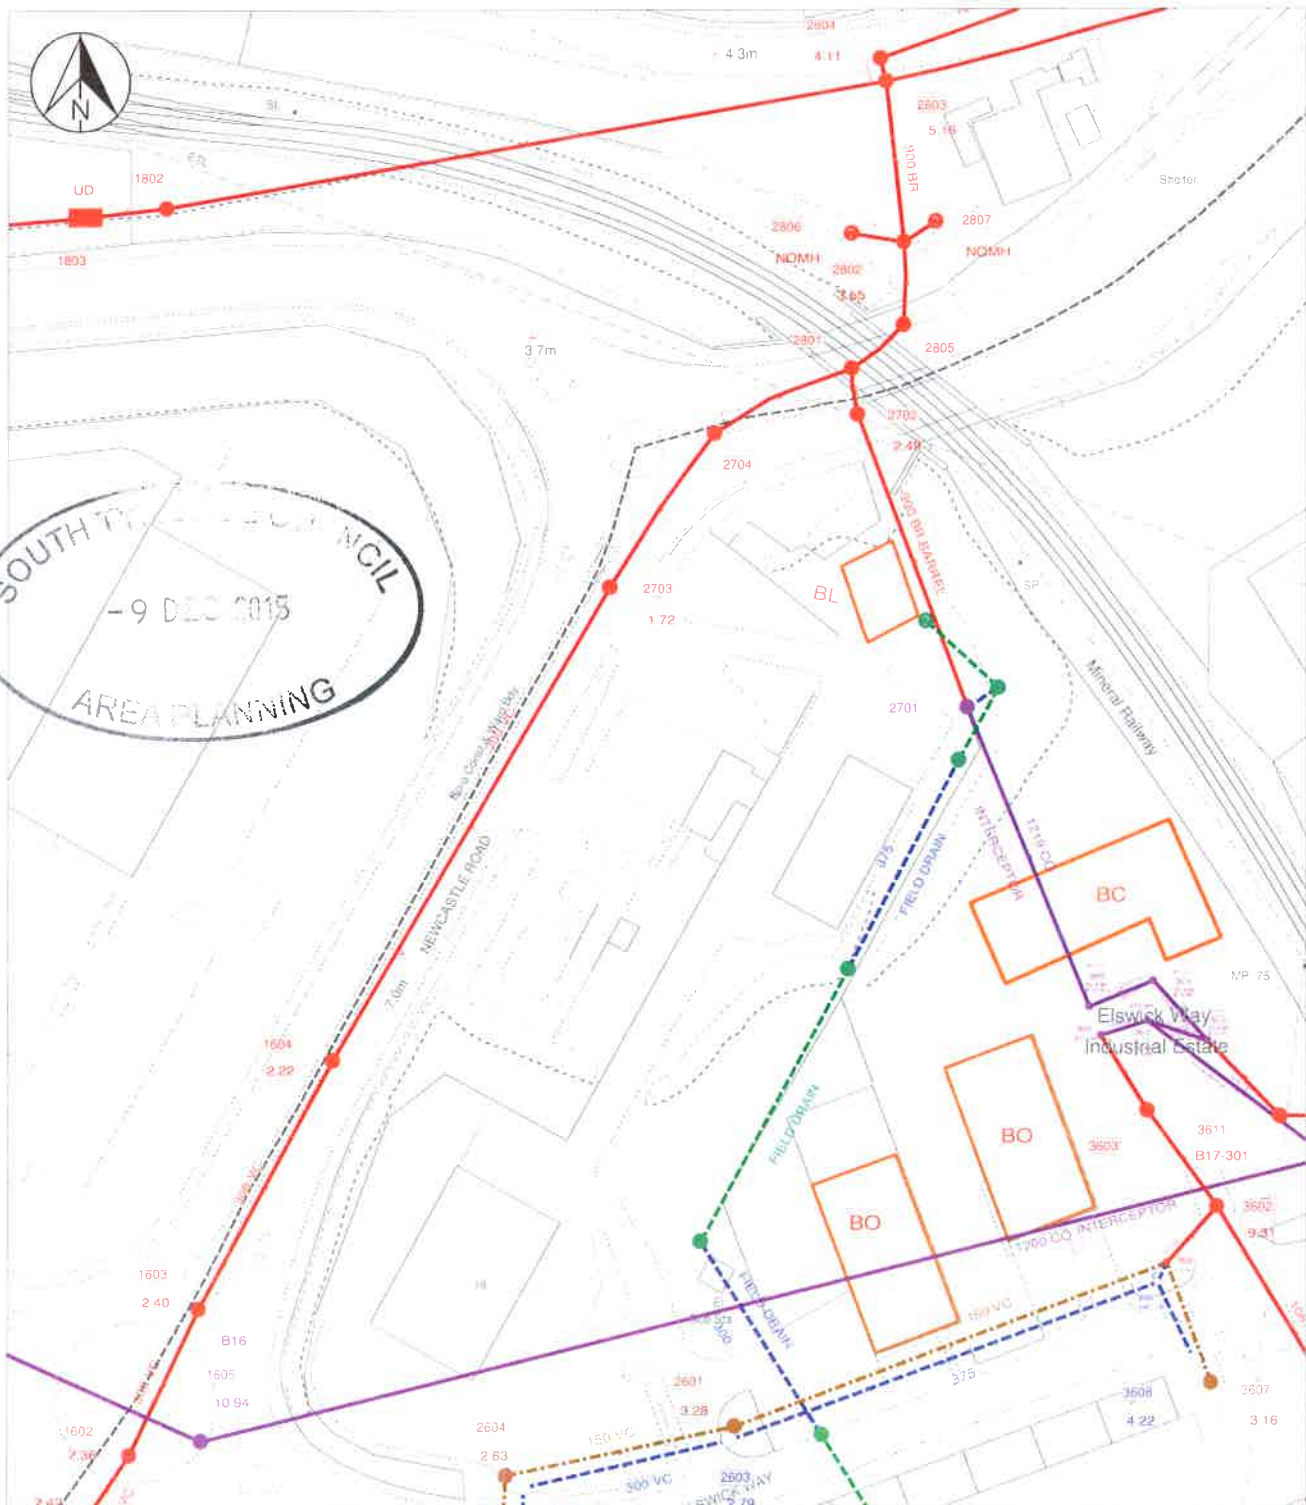

User : DAWSJ1  
 Title : 0000  
 Centre Point : 435237,564736

Date : 16/07/2015 09:24:14  
 Map Sheet : NZ3564NW  
 Paper / Scale : A4@1:1250

The material contained on this plot has been reproduced from an Ordnance Survey map with permission of the controller of H.M.S.O. Crown Copyright Reserved. Licence No: WU298506  
 The information shown on this plan should be regarded as approximate and is intended for guidance only. No Liability of any kind whatsoever is accepted by Northumbrian Water, its servants or agents for any omission. The actual position of any water mains or sewers shown on the plan must be established by taking trial holes in all cases. In the case of water mains Northumbrian Water must be given two working days notice of their intention to excavate trial holes. Private connections are not shown but their presence should be anticipated.  
 WARNING: Where indicated on the plan there could be abandoned asbestos cement materials or shards of pipe. If excavating in the vicinity of these abandoned asbestos cement materials, the appropriate Health & Safety precautions should be taken. Northumbrian Water accepts no liability in respect of claims, costs, losses or other liabilities which arise as the result of the presence of the pipes or any failure to take adequate precautions. Emergency Telephone Number: 0845 717 1100

