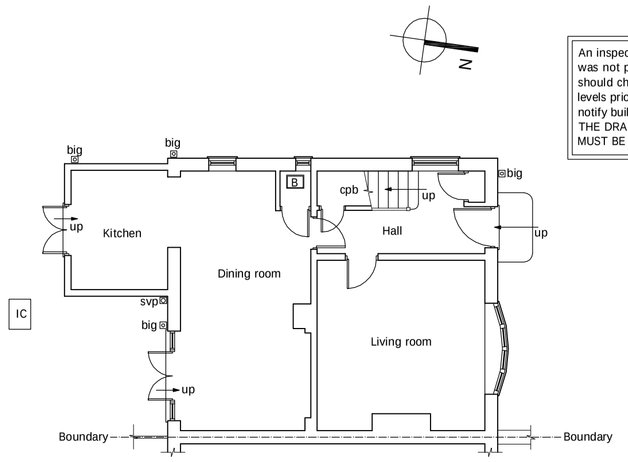

An inspection of the underground drainage was not possible on survey. Contractor should check drainage runs and invert levels prior to starting work on site and notify building control of results.
THE DRAINAGE SHOWN IS ASSUMED AND MUST BE VERIFIED BY THE CONTRACTOR.

EXISTING GROUND FLOOR PLAN
scale 1:100

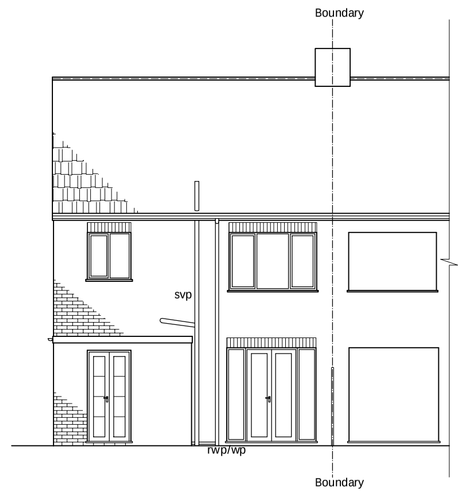

EXISTING REAR ELEVATION
scale 1:100

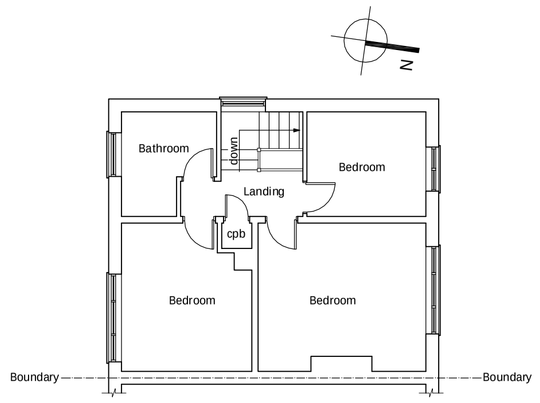

EXISTING FIRST FLOOR PLAN
scale 1:100

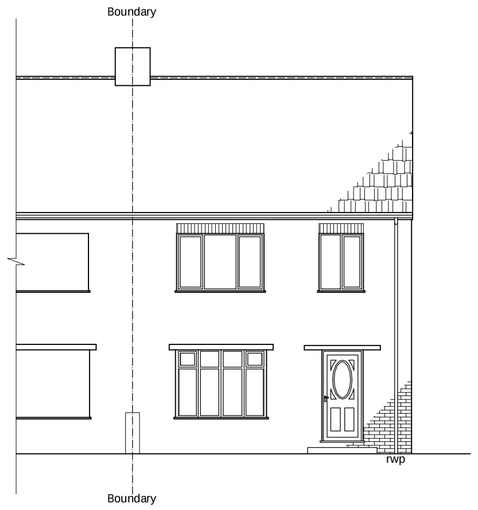

EXISTING FRONT ELEVATION
scale 1:100

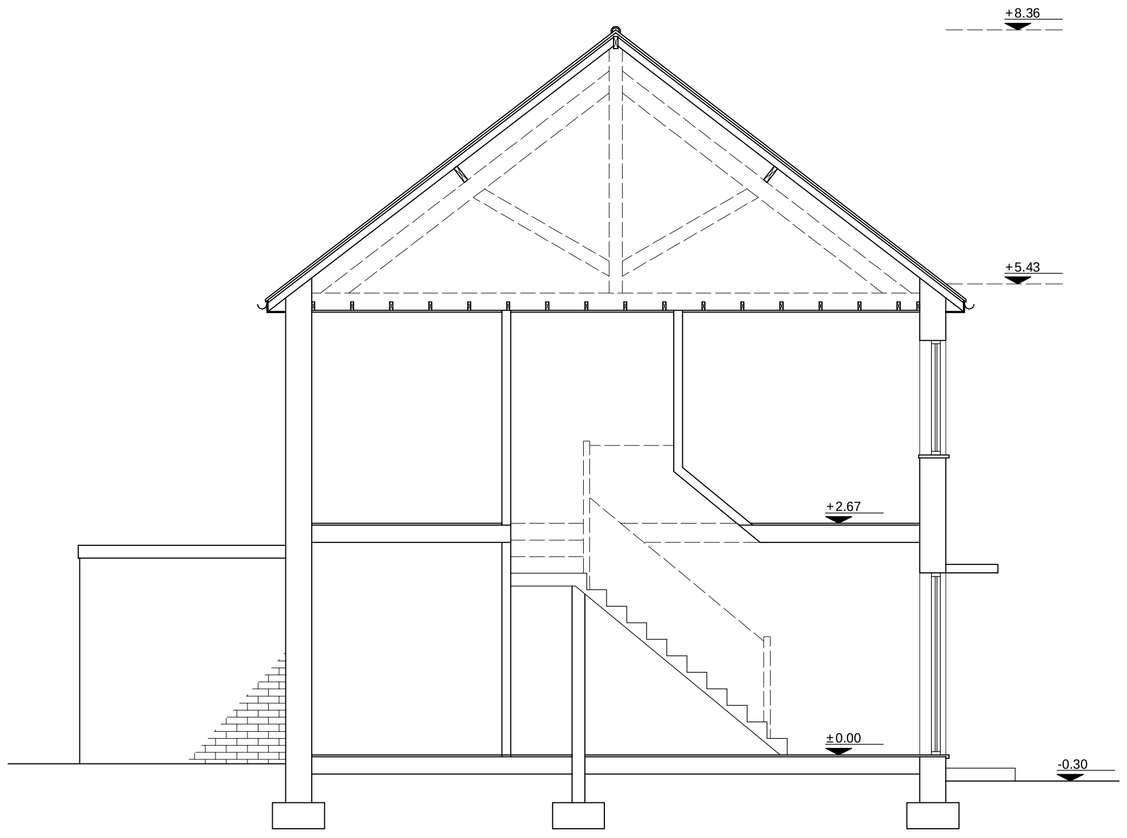

EXISTING SECTION
scale 1:50

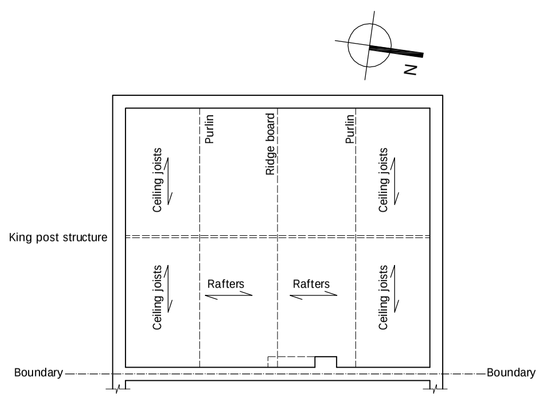

EXISTING ATTIC FLOOR PLAN
scale 1:100

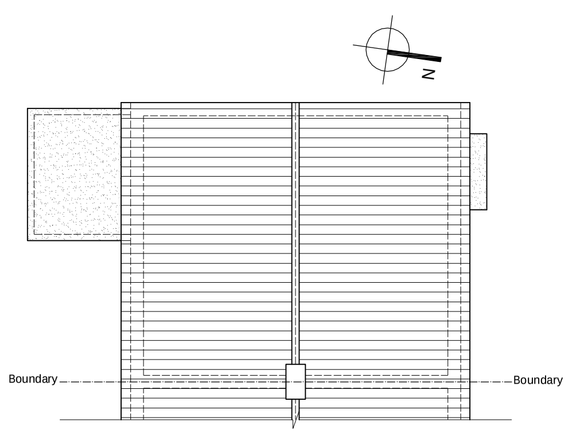

EXISTING ROOF PLAN
scale 1:100

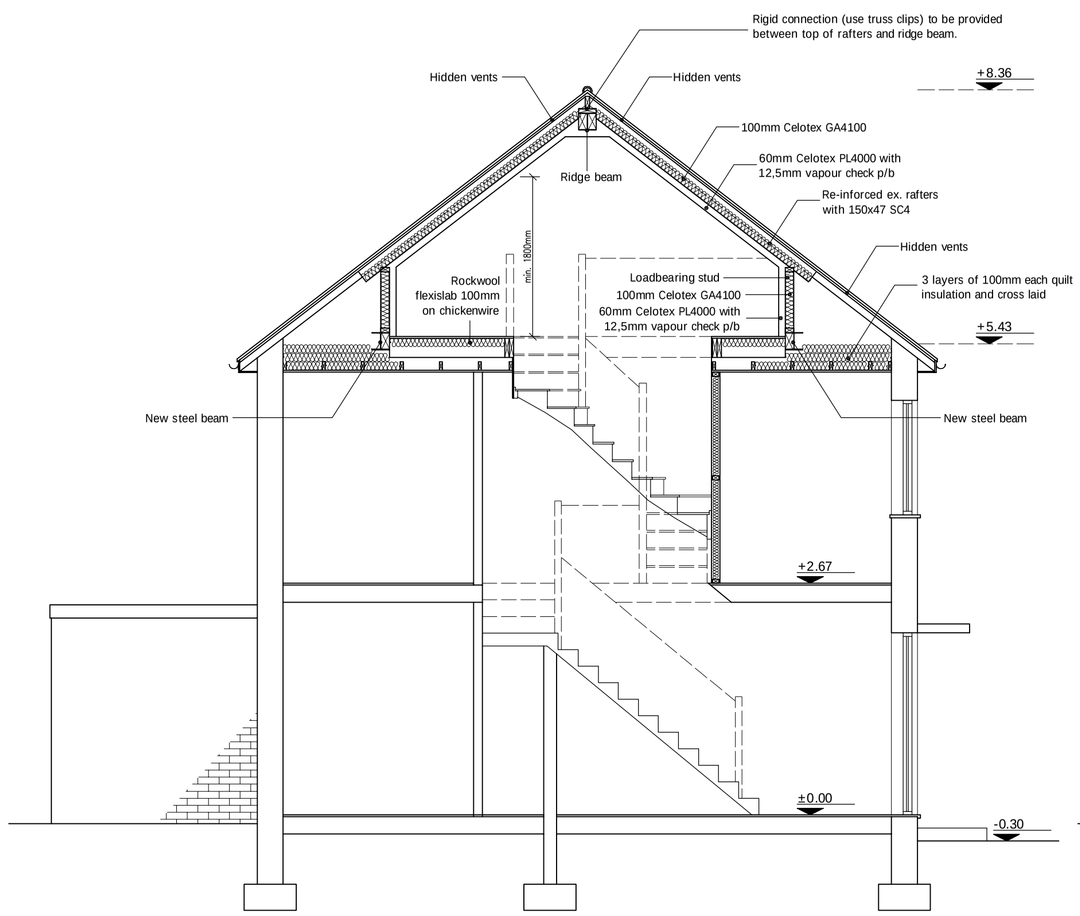

PROPOSED SECTION A-A
scale 1:50

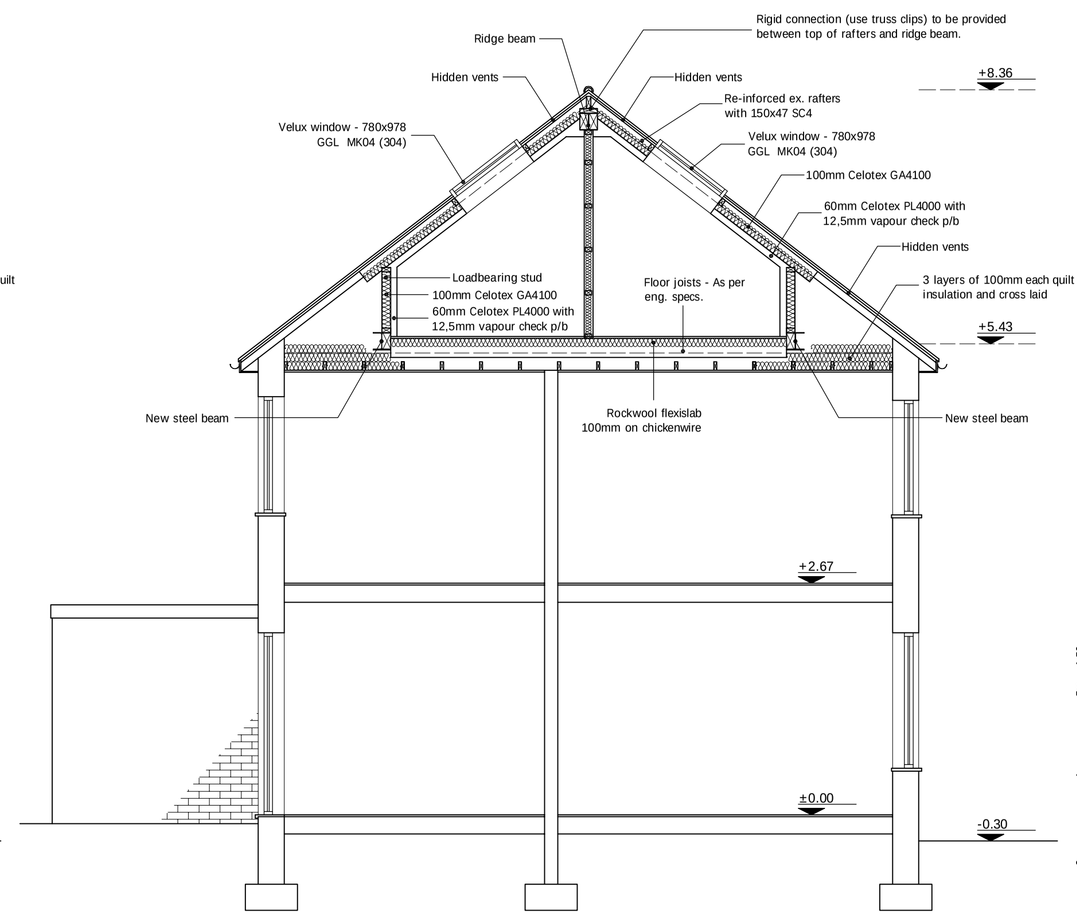

PROPOSED SECTION B-B
scale 1:50

SPECIFICATION.

GENERAL:- Loft conversion with skylights to rear. Where building to boundaries the adjacent owner is to be informed under the terms of the Party Wall Act 1996 and its provisions followed. Where building over boundaries the adjacent owner is to be served notice under section 65 of the Town & Country Planning Act 1990. All dimensions must be checked on site and not scaled from this drawing. Any dimensions given are in millimetres.

1. PROPOSED ROOF STRUCTURE:- The existing rafters are to be re-inforced with min. 150mm deep rafters. Trim out with doubled (to be confirmed by Structural Engineer) rafters where required for new skylights. 100mm Celotex GA4000 insulation set beween rafters with min 50mm ventilation gap maintained to underside of sarking felt and fixed across face of rafters with a further 60mm Celotex PL4000 insulation with 12.5mm plaster board (vapour check type) and skim finish. All to give a U-value of 0.15. The existing ceiling joits and rafters are to be retined. New timber joists and steel beams to be 30mm clear of existing ceiling construction. Support provide to rafters at eaves on via stud at 400mm c/c supported on new steel bearer beam. New hidden roof vent tiles at front and rear eaves to be provided with equal capacity of 25mm wide continuous strip ventilator. Same vents type to be provided at both sides of the ridge with equal capacity of 5mm continuous strip ventilator. All velux windows to have EDN type flashing for flush fit installation. Velux windows are AA rated.

2. LATERAL RESTRAINT TO FLOOR AND ROOF:- All floors and roofs to be anchored by Bat or Catnic metal anchors (30 x 5 mild steel). Straps to be secured to timber and walls min. 1000mm long at max. 1200mm c/c (1800m c/c in single storey construction).

3. NEW ATTIC FLOOR:- 22mm T&G flooring grade chipboard (V313 grade water resistant to new shower room) to timber floor joists as per Structural Engineer calculations and drawings, supported on new steel beams. Trimmers to floor and for stair opening to be as per Structural Engineer drawings. Floor joists doubled below all new non load bearing stud partitions. Provide for mid span herringbone strutting. Provide for Chickenwire mesh laid over the existing ceiling joist with 100mm Rockwool flexislab (for half hour fire protection to the existing ceiling) set between and carried to eaves voids where it is to be overlaid with 2x 100mm Rockwool quilt insulation. To give a total thicknes to unheated voids of 300mm and all to give a U-value of 0.15 or better.

4. LINTELS & STEELWORK:- Unless otherwise stated lintels to be Catnic combined steel to BS5977 (sizes as recommended by manufacturer). Provide min. 150mm end bearing where bearing is less than 150mm concrete padstones are to be provided (sizes to suit load and detail). All lintel backs and soffits to have min. half hour fire resistance and be insulated to prevent cold bridging where necessary. New main bearer beams to be as per drawings, all beams to be supported via steel bearer plates each end. Half hour fire protection to be provided for steel beams.

5. DAMP PROOF COURSES:- Horizontal and vertical DPC's will comply with BS743 (pitch polymer) and be incorporated:

(a) min. 150mm above ground to all load bearing walls, lapped with floor damp proof membrane.

(b) Vertically built into jambs of all external openings.

(c) Horizontally stepped to all external openings.

6. DRAINAGE:- The existing drainage system is assumed to be a single line combi system (to be confirmed on site). There are no alterations to the below ground drainage system. Extend existing svp to terminate at min. 900mm above any opening and finished with wire cage at top. Provide for boss type connectors to deep seal traps for sink and bath wastes. Rodding access provided to attic. Safe operation of all types of hot water systems are required to prevent scalding, so the temperature does not exceed 48 degree celsius through taps or 100 degree celsius where held in storage, (i.e. by use of temperature relief valves). Reasonable provisions must be made by the installations of fittings and fixed appliances that use water efficiently for the prevention of undue consumption of water. New rainwater goods to match existing.

7. TIMBER PARTITIONS:- 100x50mm vertical softwood studs at 600mm c/c secured to 100x50mm head and sole plates. Noggins at 600mm intervals. 12.7mm Gyproc plasterboard and skim finish to both sides. Provide 25mm Isowool APR 1200 sound insulation to partition voids at bathrooms and around bedrooms to comply with E2 requirements for sound deading. Floor joists to be doubled up when running parallel with and under timber partitions. Stud to front eaves to be 100x50mm at 400mm c/c to provide support to re-inforced rafters. 100mm Celotex GA4000 insulation set between studs with further 60mm Celotex PL4000 insulation (with 12.5mm plasterboard - vapour check type, manufactured fixed and skim finish) fixed across face of studs, all to give a U-value of 0.18 or better.

8. FIRE PRECAUTIONS:- All doors to stairway serving habitable rooms are to be FD20 doors with 25x38mm rebates and provided with either with intumescent strip or 35x25mm doorstops glued and screwed at 200mm c/c (existing to be replaced with new). All new internal doors to have min. undercut of 10mm above the fitted floor finish surface. 18mm fireline board to underside of new staircase to skim finish. Smoke alarms must be provided at each landing level. The fire alarm system to be at least a Grade D2 Category LD3 in accordance with BS 5839-6. Smoke alarms to be mains operated and inter linked and conform to BS EN 14604 whilst heat alarms to be to BS 5446-2. The alarms to have a standby power supply, such as battery back-up. Any glazing to the stairway enclosure to be replaced with fire-resisting (un-insulated) glazing retained by a suitable glazing system and beads compatible with the type of glass. As well as the new floor having thirty minutes fire resistance, any floor forming part of the protected stair enclosure between the loft conversion and final exit should be upgraded to achieve 30 minutes fire resistance.



drawnplans.co.uk

Project:
Loft Conversion with Skylights to Rear.

For:
Keiran Webster
36 Steward Crescent
South Shields
Tyne And Wear
NE34 7EJ

Scale:	Dwg. no:	Ref. no
As shown	Sheet 1	A0C
Drawn by: L.R.	Date Drawn: 13-March-2023	

For Drawings Tel: 0800 7836790

E-mail :- drawnplansco@aol.com