

NEW GRP LAYOUTS AND ELEVATIONS

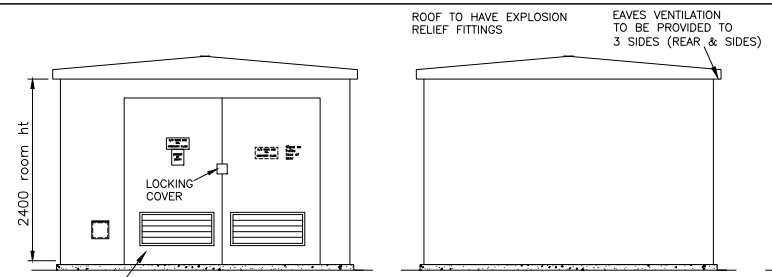


FRONT ELEVATION


REAR ELEVATION

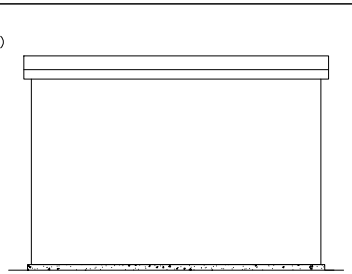


SIDE ELEVATION

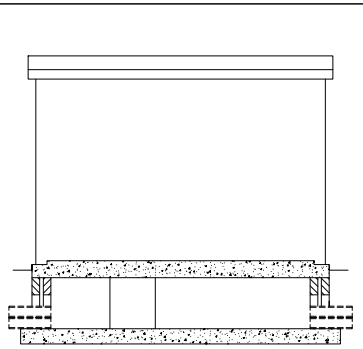

SECTION A–A

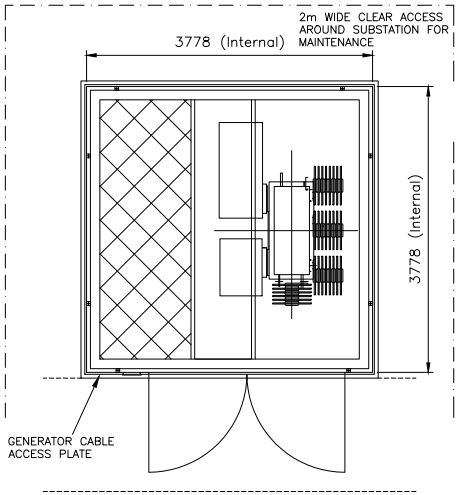

ELECTRICAL LAYOUT

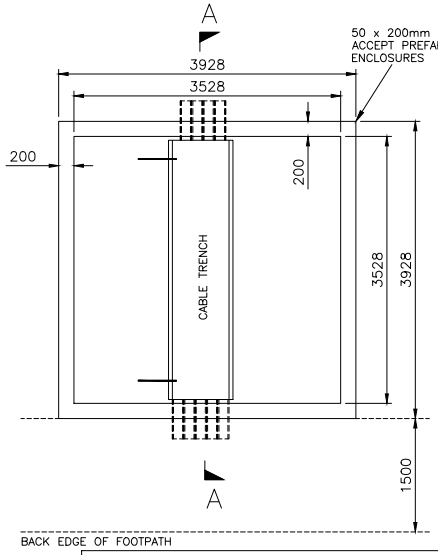

PLAN

NOTES

Substation doors to be set back a minimum of 1500mm from back edge of footpath. Any proposed reduction in this clearance to be approved by Northern Powergrid following submission of site specific risk assessment and operational method statement.

NORTHERN POWERGRID

SOUTH SHIELDS TE, CROSSGATE, SOUTH SHIELDS, NE33 4PE

Manufacturer Details

315 – 1000kVA SLIDE IN UDE IN PREFABRICATED ENCLOSURE

Sheet No.	Scale	Document Details
1	AS SHOWN	GENERAL ARRANGEMENT / PLAN & ELEVATIONS
Prepared By: TM		
Revised	Grid Reference	Ref No. C1063405 / Historic Drawing No.
Date Issued: 17.05.16	Checked By: JJ	Revision: A / Notes

Copyright of Northern Powergrid (Yorkshire) Plc, may not be reproduced without prior permission

SCALE 1:100 @A4