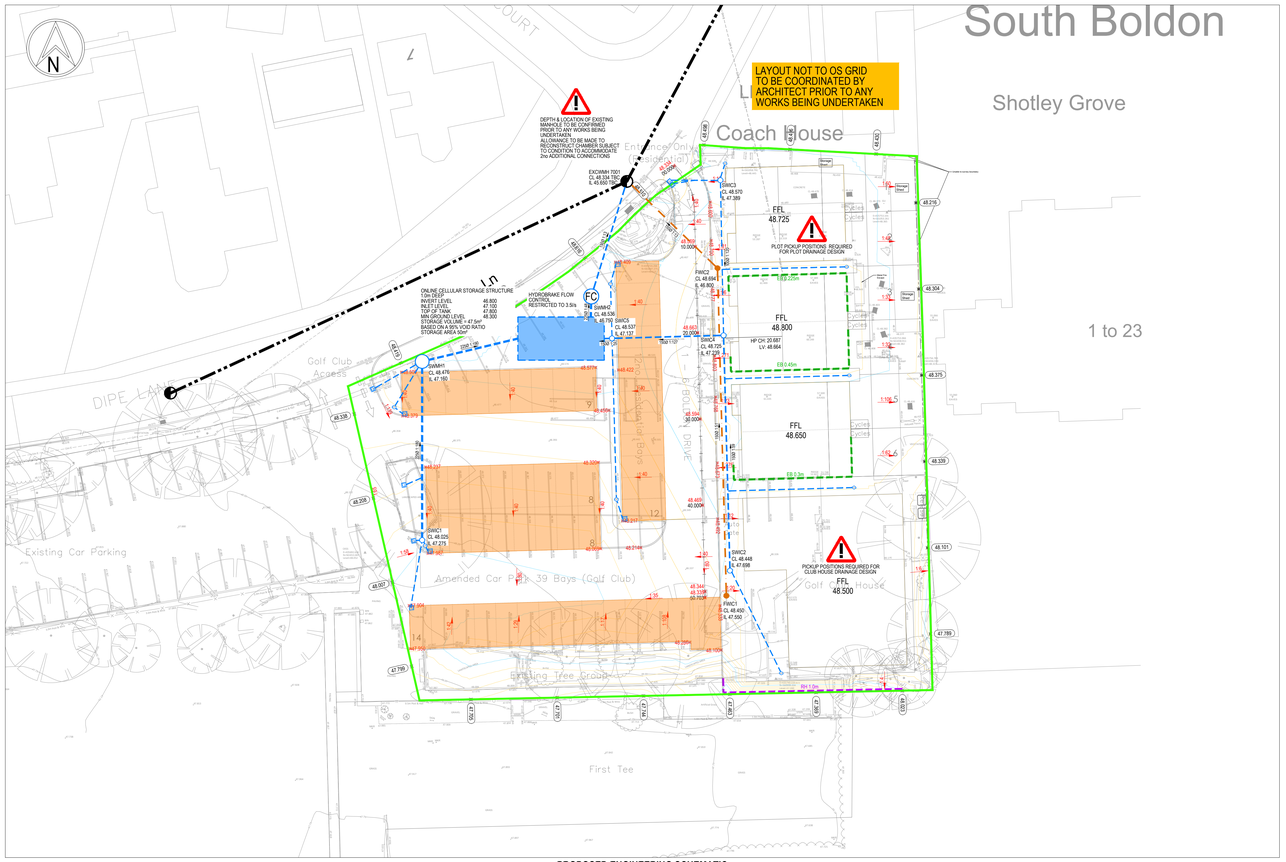
South Boldon
Shotley Grove
1 to 23
LAYOUT NOT TO OS GRID TO BE COORDINATED BY ARCHITECT PRIOR TO ANY WORKS BEING UNDERTAKEN
Coach House
DEPTH & LOCATION OF EXISTING SERVICES TO BE CONFIRMED PRIOR TO ANY WORKS BEING UNDERTAKEN. ALLOWANCE TO BE MADE TO RECONSTRUCT ANY PIPES SUBJECT TO DIVERSION TO ACCOMMODATE 2no ADDITIONAL CONNECTIONS
EXCHMH 7001 CL 48.338 TBC EL 45.600 TBC
ONLINE CELLULAR STORAGE STRUCTURE 1Um DEEP INVERT LEVEL 46.800 TOP OF SLAB 48.800 TOP OF COVER 47.800 MIN GROUND LEVEL 48.300 STORAGE VOLUME = 47.5m³ BASED ON A 95% VOID RATIO STORAGE AREA = 50m²
HYDROBRAKE FLOW CONTROL RESTRICTED TO 3.5l/s
FC
SWMH2 CL 48.536 TBC EL 46.750 TBC
SWC5 CL 47.137
SWC4 CL 48.725 TBC
SWC3 CL 48.570
SWC2 CL 48.448
SWC1 CL 48.025
FWC1 CL 48.450 EL 47.550
FWC2 CL 48.694
FFL 48.725
FFL 48.800
FFL 48.650
FFL 48.500
PLOT PICKUP POSITIONS REQUIRED FOR PLOT DRAINAGE DESIGN
PICKUP POSITIONS REQUIRED FOR CLUB HOUSE DRAINAGE DESIGN
HP CH: 20.681 LV: 48.664
EB 0.45m
EB 0.3m
EB 0.3m
Golf Club Access
Existing Car Parking
Amended Car Park - 39 Bays-(Golf Club)
Entrance Only
Exit Only
First Tee
Golf Course
Golf Course Boundary
Boundary Fence
Boundary Wall
Hedge
Tree
Manhole
Gully
Kerb
Edge of Tarmac
Edge of Path
Edge of Grass
Edge of Concrete
Top of Bank
Bottom of Bank
Fence