

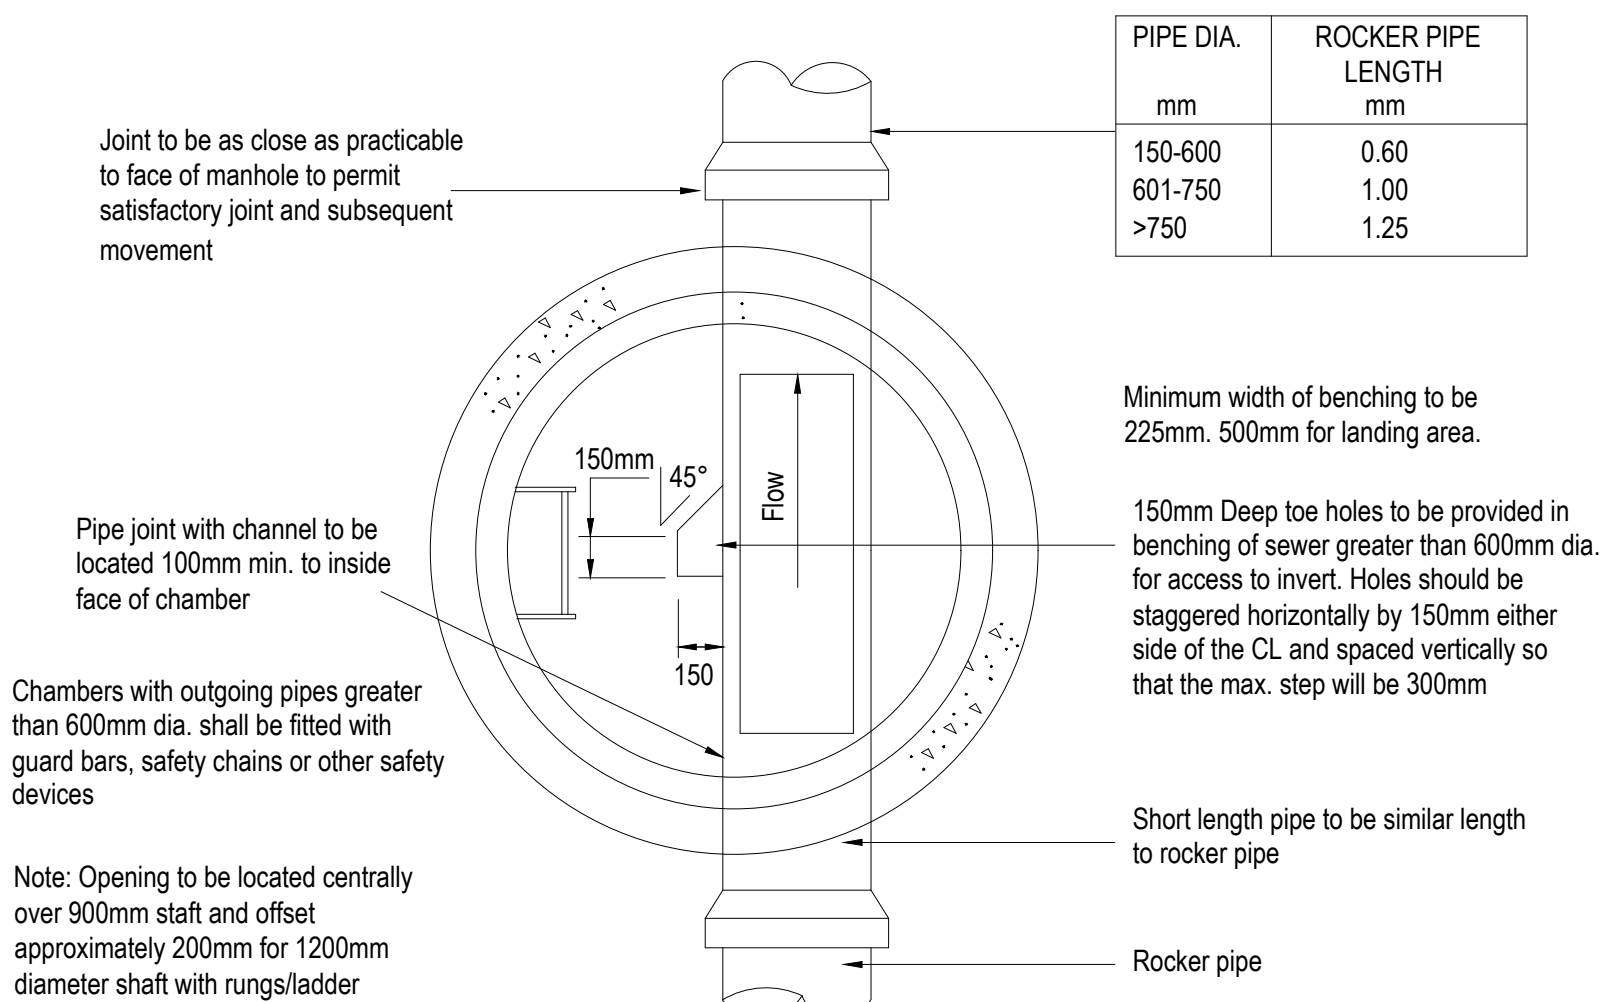


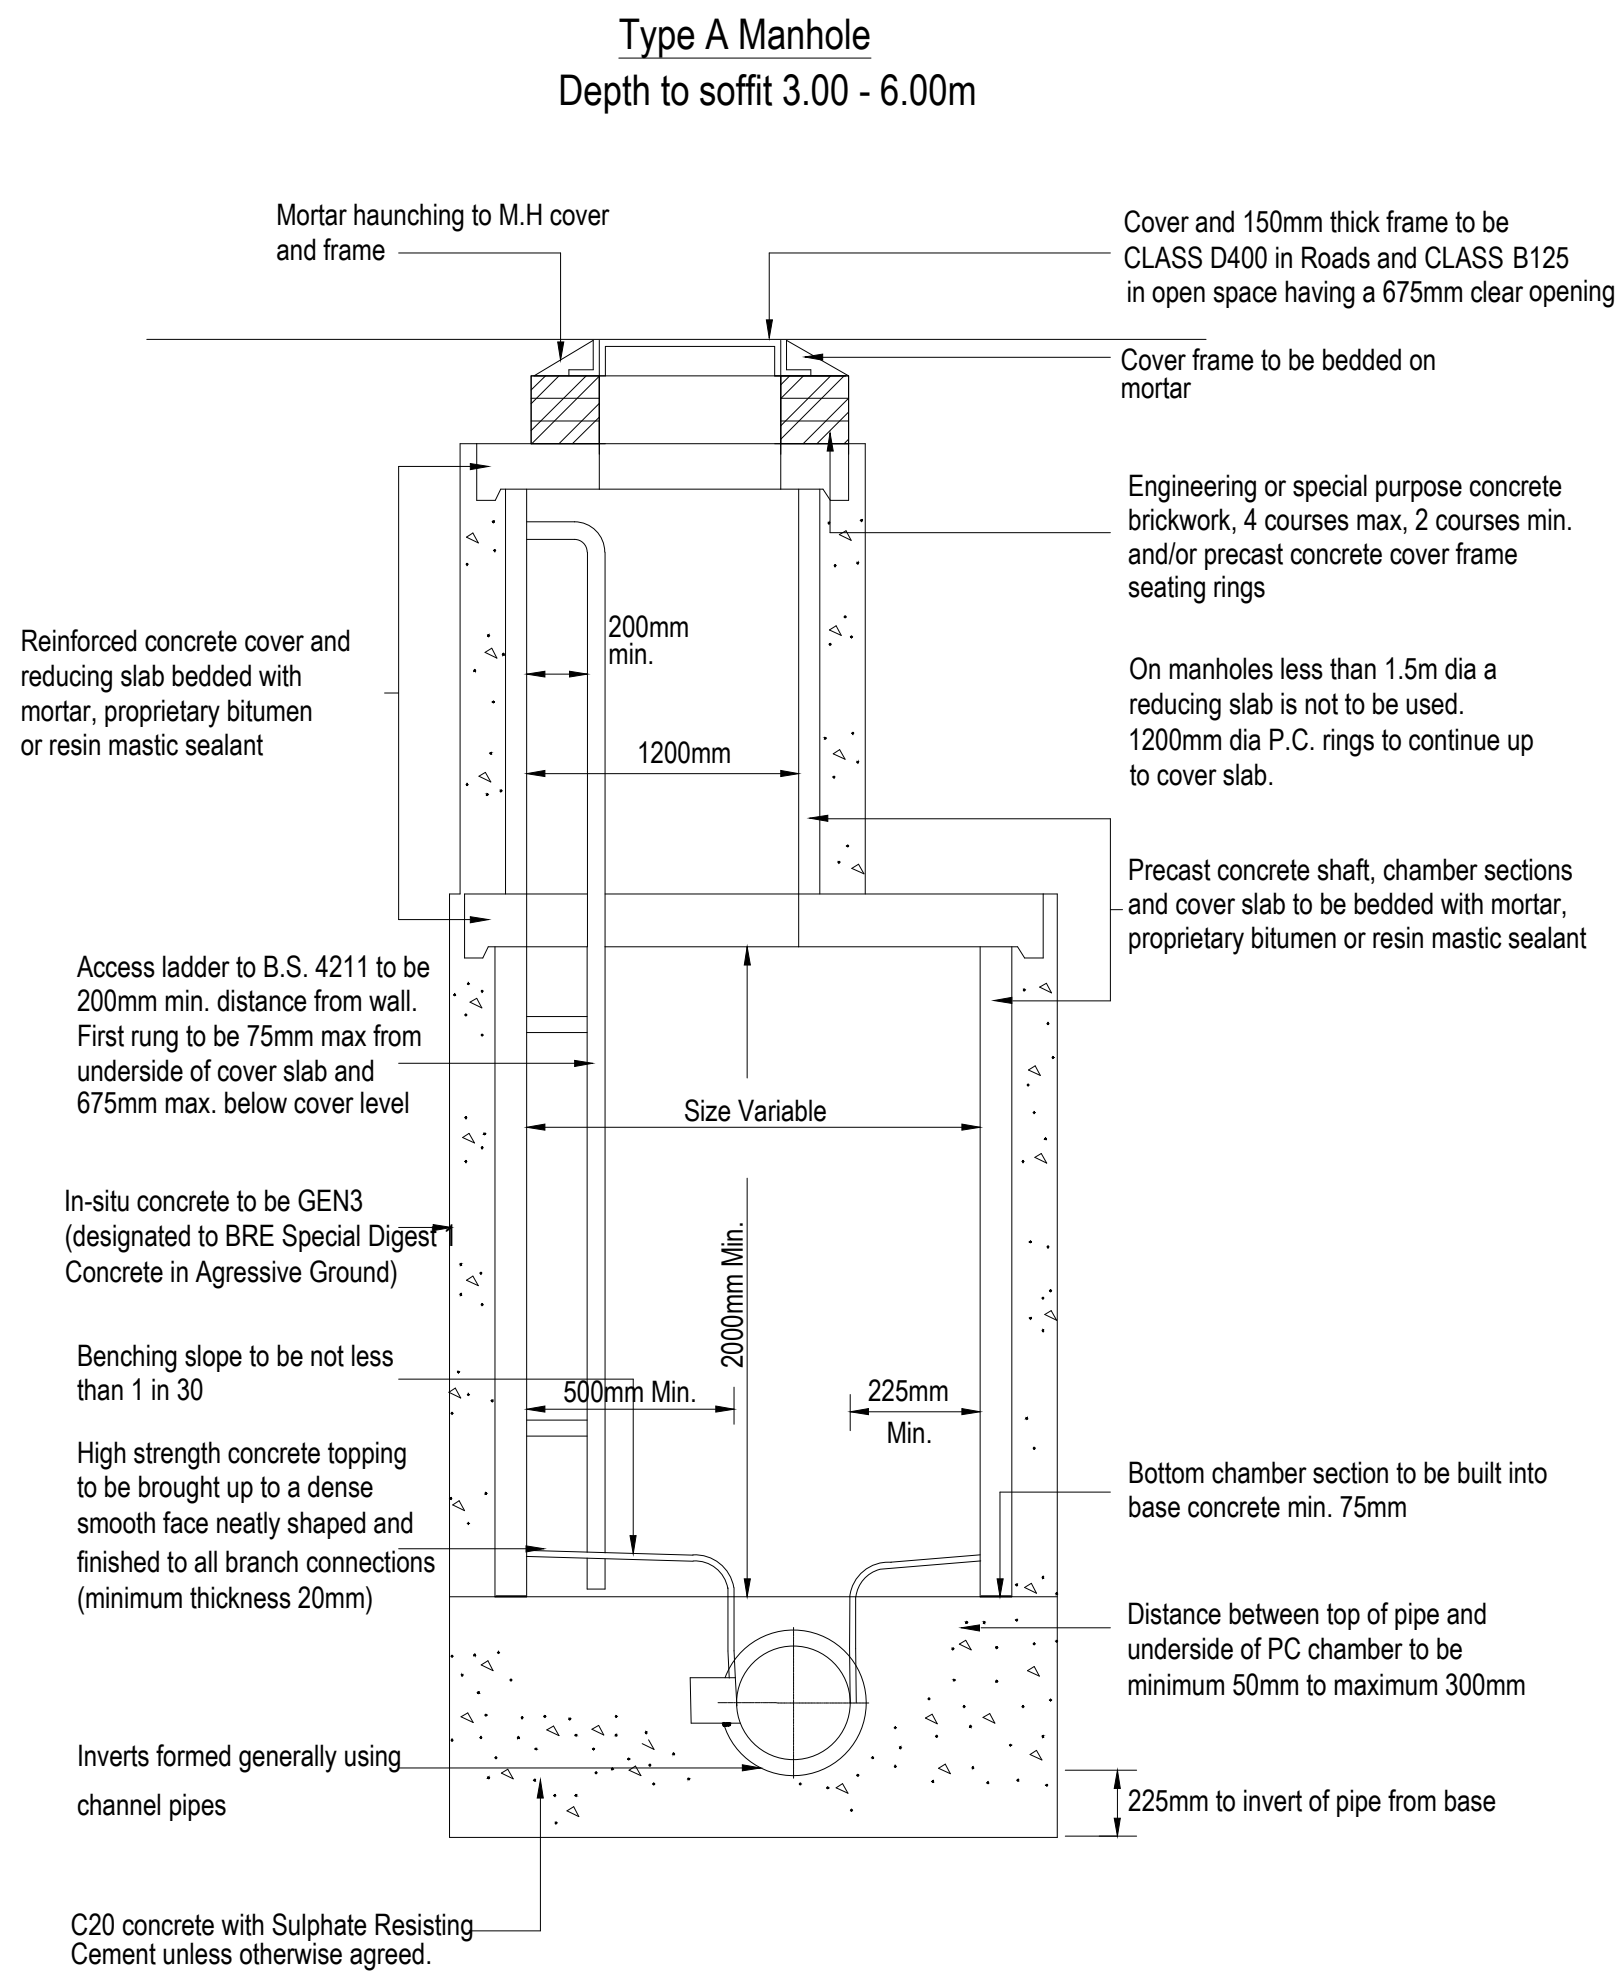


PIPE DIA. mm	ROCKER PIPE LENGTH mm
150-600	0.60
601-750	1.00
>750	1.25



DIAMETER OF LARGEST PIPE IN MANHOLE (mm)	INTERNAL DIAMETER OF MANHOLE (mm)
less than 375	1200
375 - 700	1500
750 - 900	1800
Grater than 900	Consult Undertaker

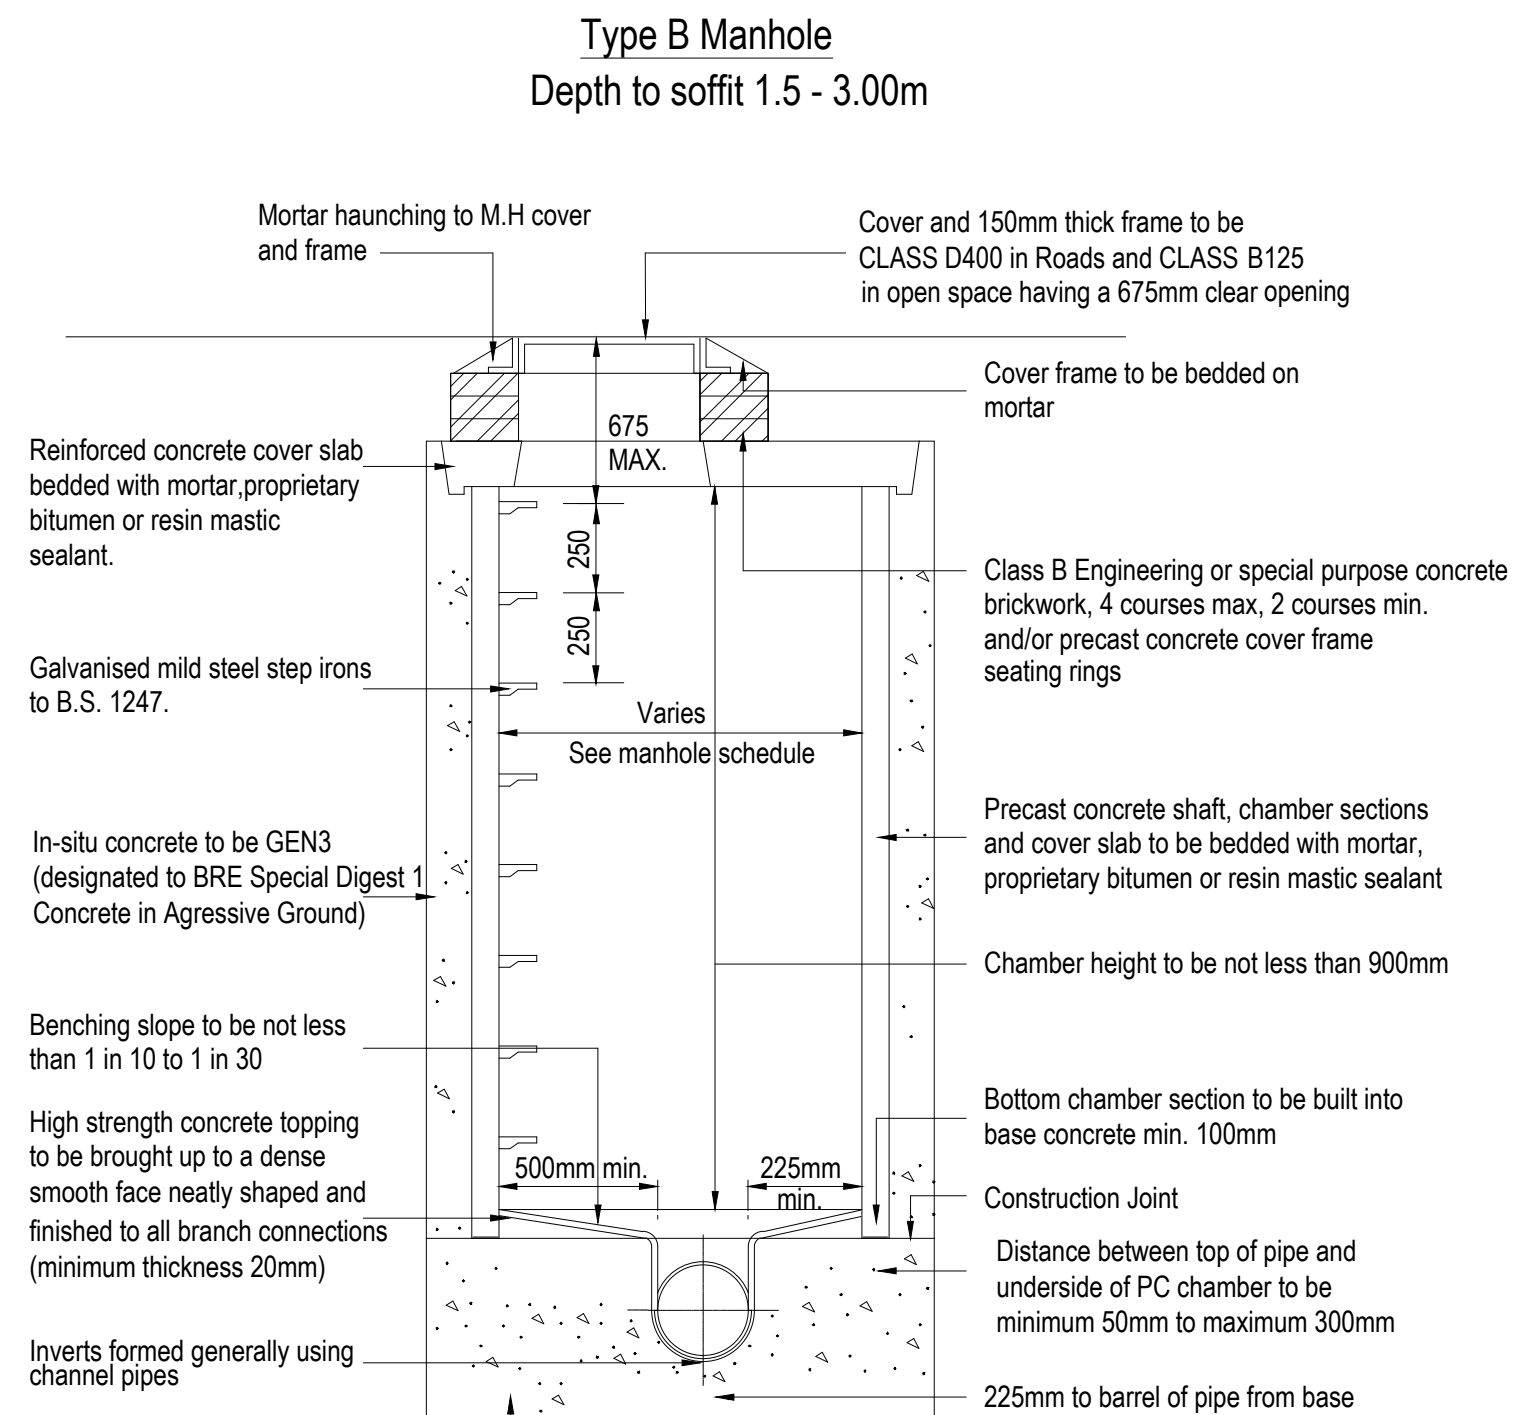


PIPE DIA. mm	ROCKER PIPE LENGTH mm
150-600	0.60
601-750	1.00
>750	1.25

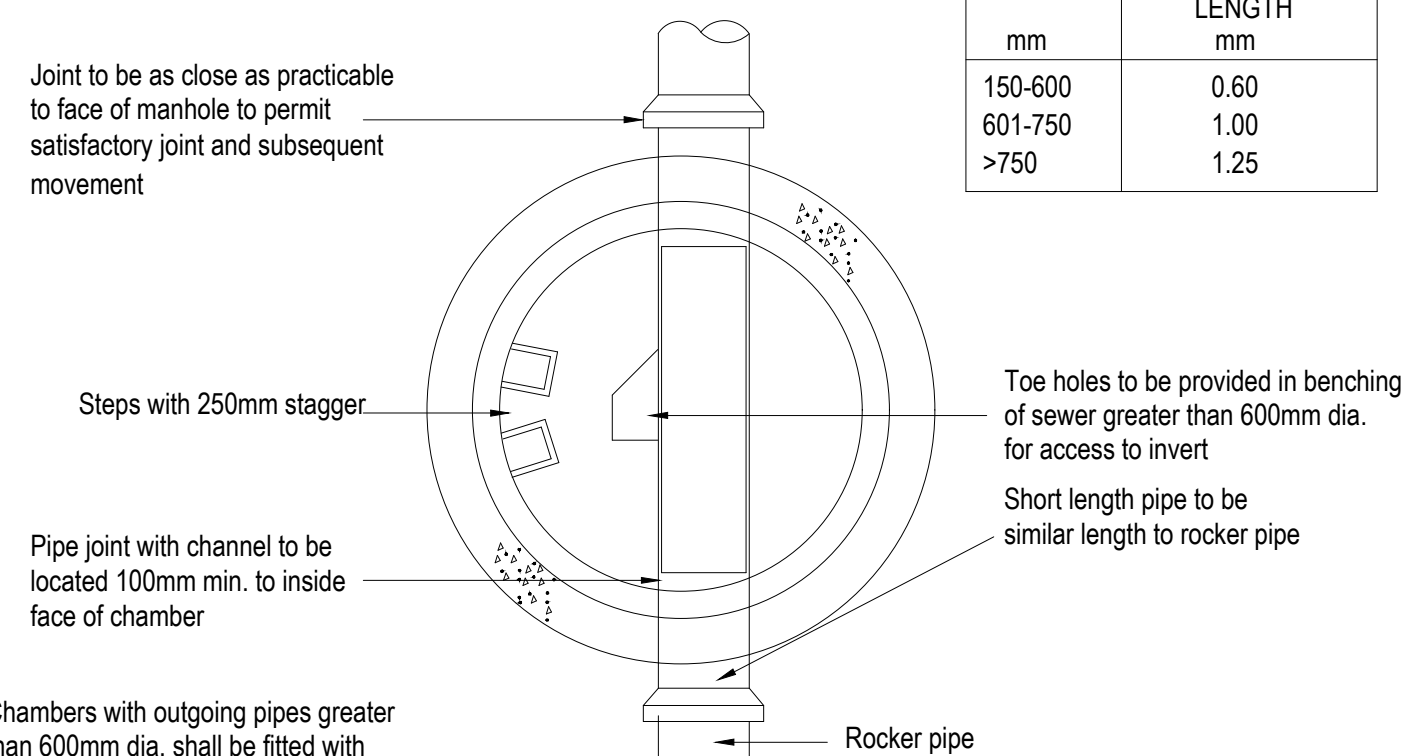


ALL SEWERAGE WORKS TO BE IN ACCORDANCE SEWERS FOR ADOPTION - 6th EDITION.

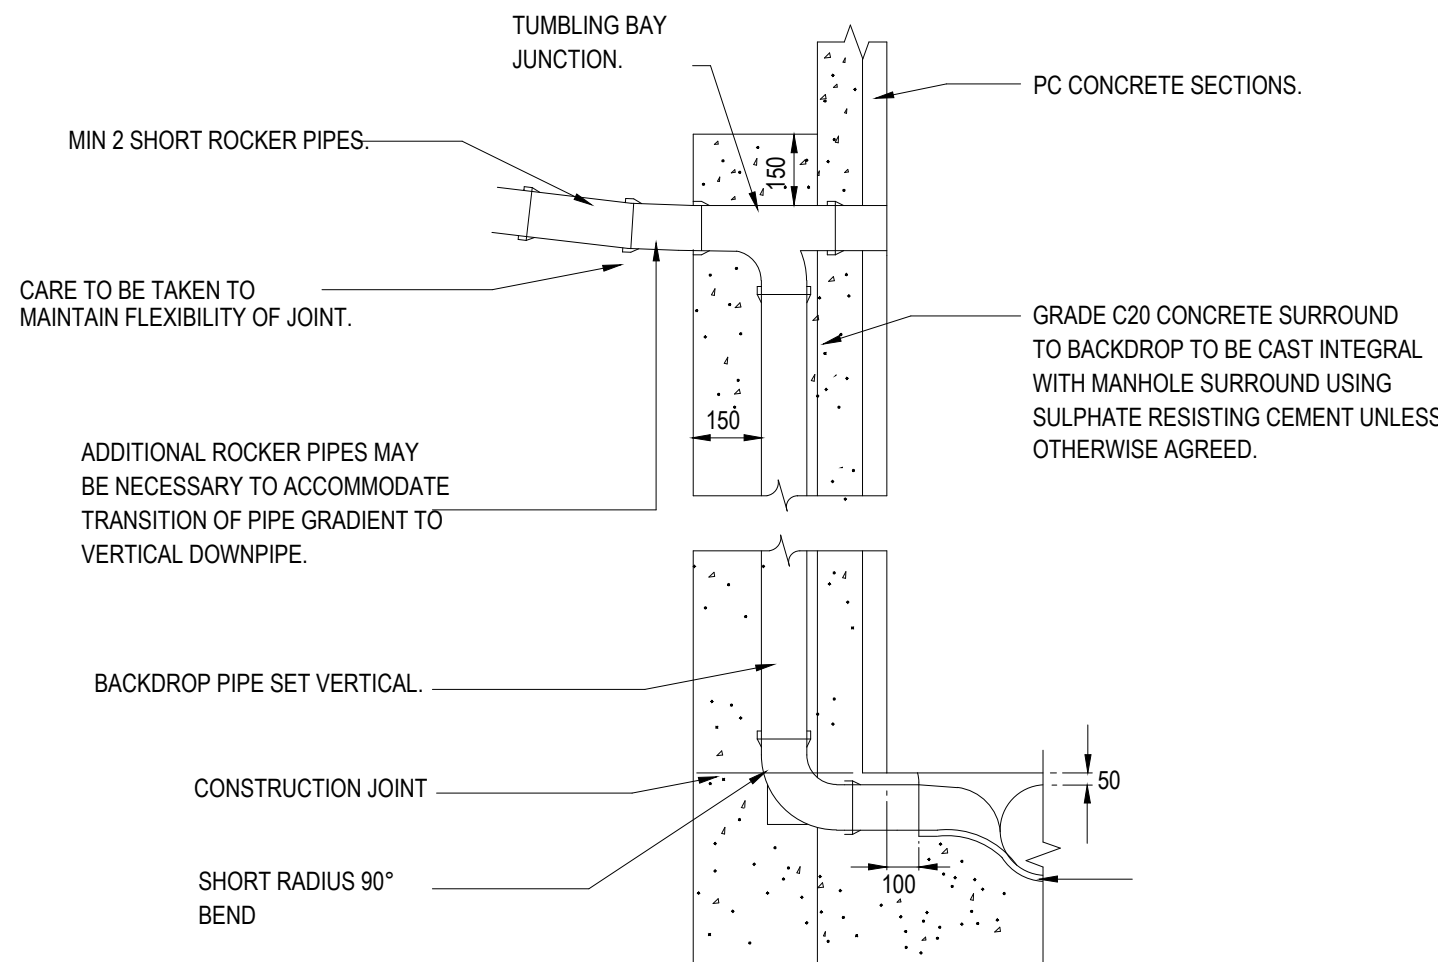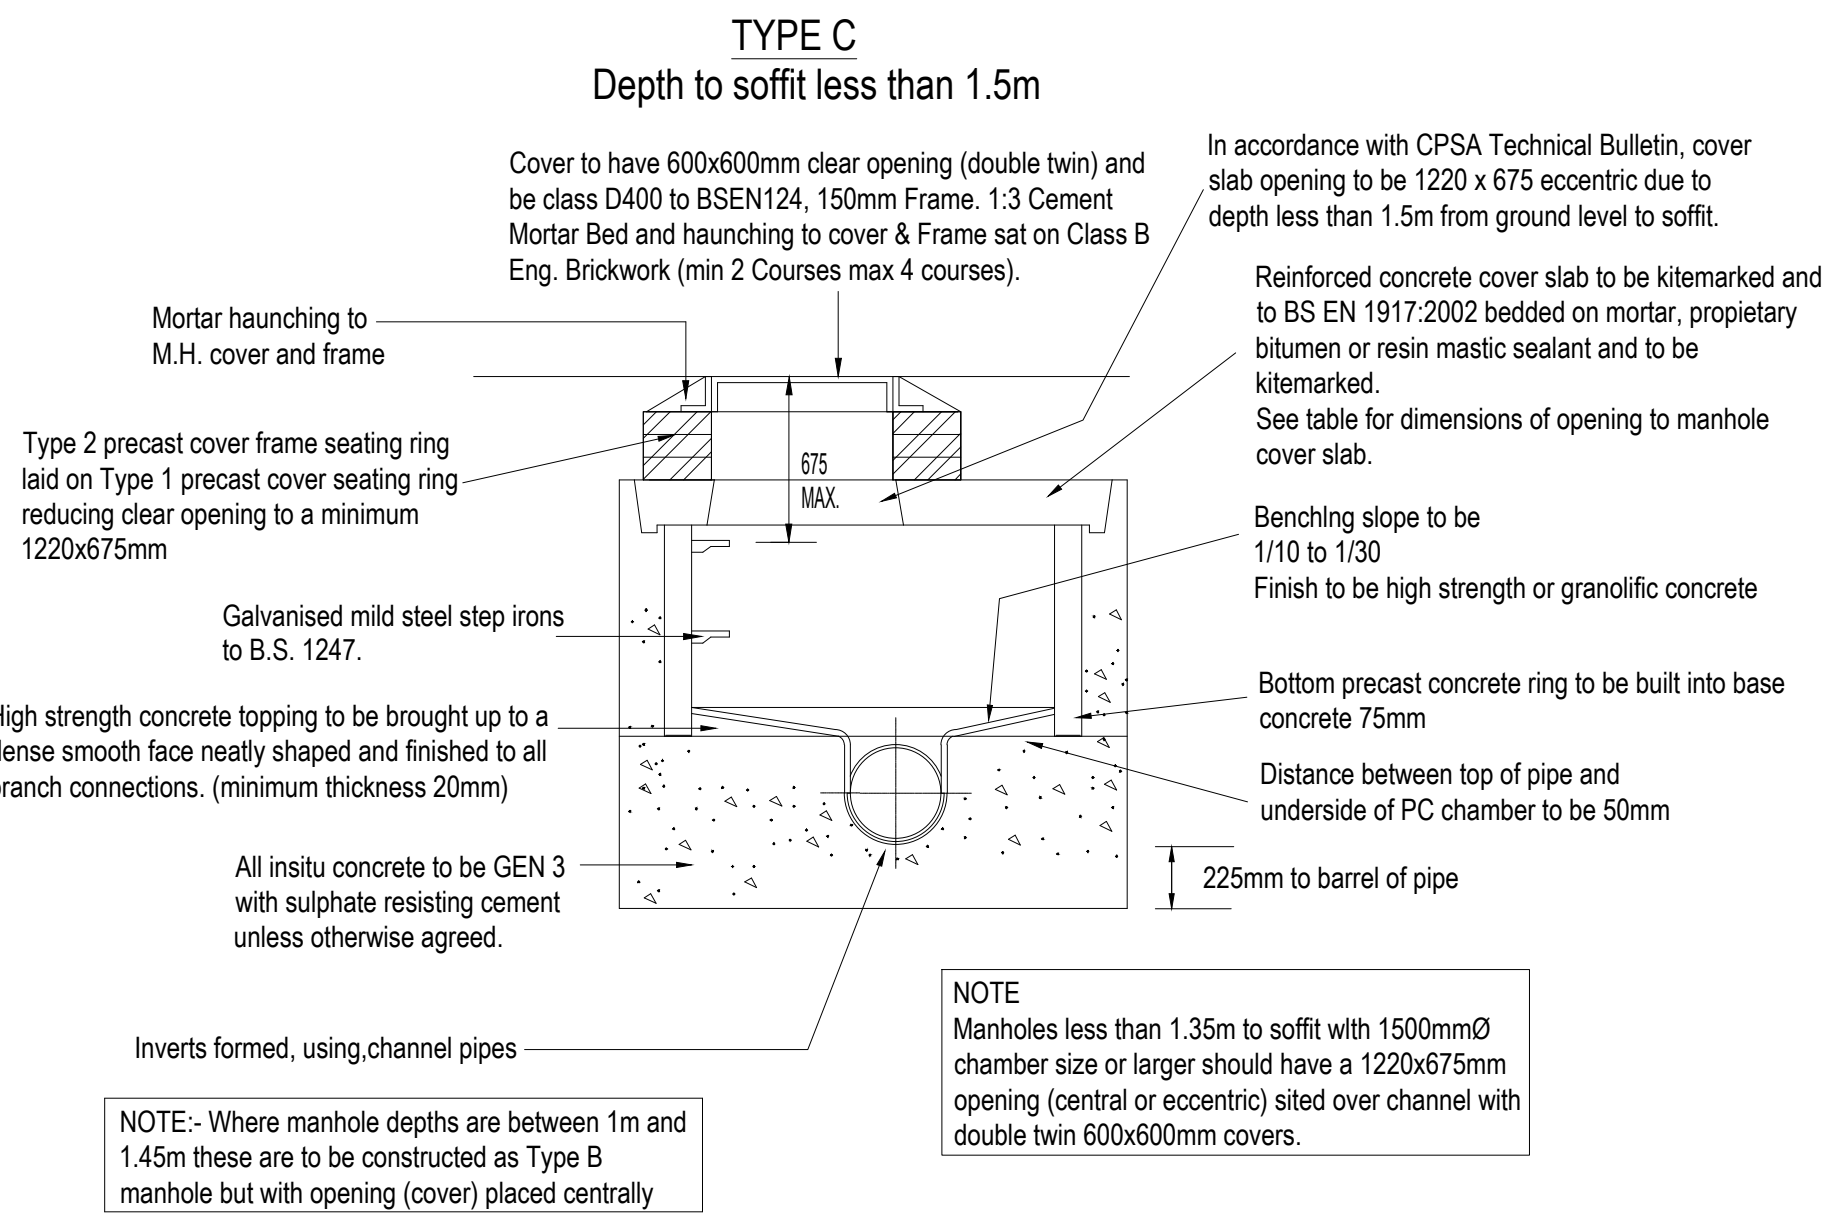

TYPICAL EXTERNAL VERTICAL BACKDROP DETAIL.
(Please refer to External Works Drawings for Locations)

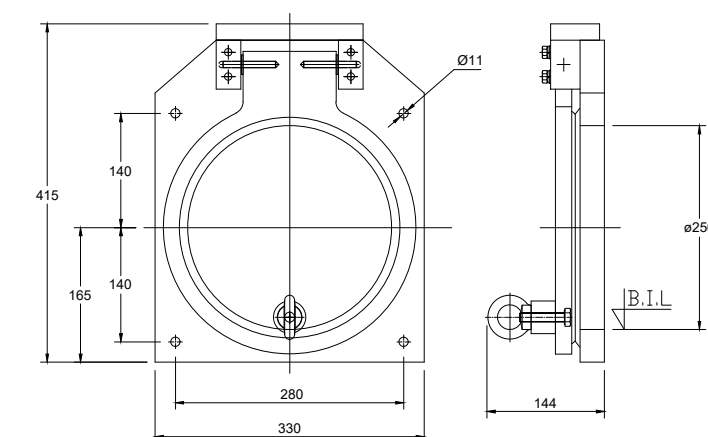

ALTHON NON RETURN VALVE DETAIL

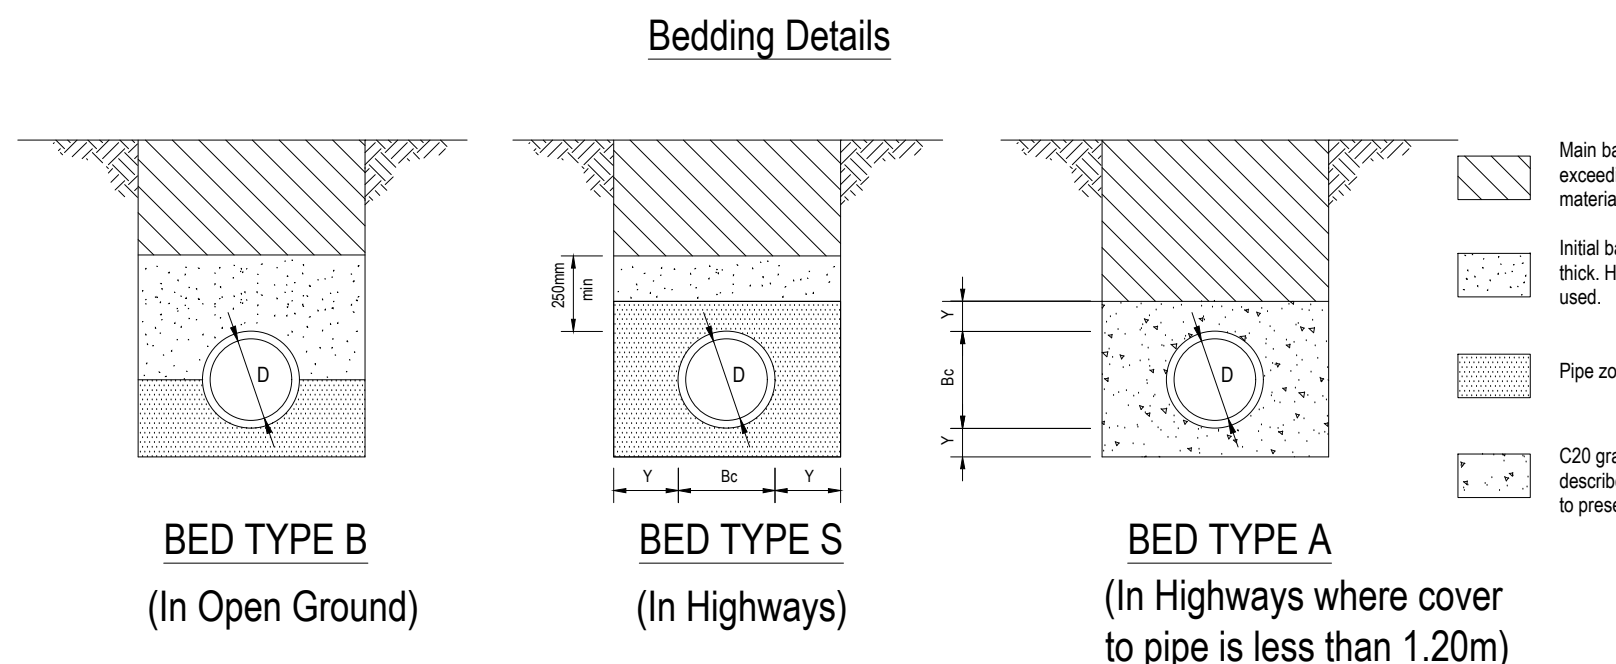

Bedding Table					
Diameter mm	Max Trench Width	Bc (mm)	Pipe Bedding Material		
			Single size (mm)	Graded (mm)	
150	900	178	10 or 14	14-5	
225	1021	271	10, 14 or 20	14-5 or 20-5	
300	1160	410	10, 14 or 20	14-5 or 20-5	
375	1240	490	14 or 20	14-5 or 20-5	
450	1326	576	14 or 20	14-5 or 20-5	
525	1420	670	14, 20 or 40	14-5, 20-5 or 40-5	
600	1522	772	14, 20 or 40	14-5, 20-5 or 40-5	

All granular material to comply with the requirements of BS 882:1983

Concrete Mixes and Workability
1. Standard concrete mixes in accordance with BS 5328 shall be used with a 20mm nominal maximum size of aggregate and a 75mm slump. Suitable applications for the concrete mixes are shown in the following table.

Standard Mix	Grade of concrete	Applications
ST1	C7.5	Fillings, blinding, soft spots and drainage ramps
ST4	C20	All other applications

2. Compressive strength testing shall not be used to judge the compliance of a concrete but, where required by the Engineer, the Developer shall provide evidence of the batch records used to produce any concrete.
3. Additives (including calcium chloride and pigments) shall not be used in the production of concrete.

Compressible Filler and Packing for Pipelines

1. Compressible filler for interrupting concrete protection to pipes shall consist of bitumen impregnated insulating board to BS 1142, part 3 or other equally compressible material. The thickness of compressible filler shall be as follows:

Nominal diameter of pipe (mm)	Thickness of compressible filler (mm)
Less than 450	16
450 - 1200	36
Exceeding 1200	54

2. Compressive strength testing shall not be used to judge the compliance of a concrete but, where required by the Engineer, the Developer shall provide evidence of the batch records used to produce any concrete.
3. Additives (including calcium chloride and pigments) shall not be used in the production of concrete.

Mortar

1. Mortar shall be mixed only as and when required, in the relevant proportions indicated in the following table, until its colour and consistency are uniform. The constituent materials shall be accurately gauged, allowance being made for bulking of sand.

Alternative nominal mixes by volume		
Cement	sand	plasticiser
1 : 3	1 : 3	1 : 2 to 3

2. Compressive strength testing shall not be used to judge the compliance of a concrete but, where required by the Engineer, the Developer shall provide evidence of the batch records used to produce any concrete.
3. Additives (including calcium chloride and pigments) shall not be used in the production of concrete.

Only PDF/DWG Issues of this drawing are controlled. All other formats (eg. DWG/AutoCAD FILES) are UN-controlled and are used at your own risk.

GENERAL NOTES

- DO NOT USE THIS DRAWING IN ISOLATION. THIS DRAWING HAS BEEN PREPARED AS PART OF A SET AND MUST THEREFORE BE READ IN CONJUNCTION WITH ALL OTHER DRAWINGS. ANY DISCREPANCIES OR DESIGN QUERIES MUST BE REPORTED TO THE ENGINEER PRIOR TO COMPLETION OF TENDER AND COMMENCEMENT OF WORKS. FOLLOWING COMPLETION OF TENDER IT IS ASSUMED THAT DEVELOPER AND CONTRACTOR ARE IN FULL AGREEMENT WITH THE DESIGN DRAWINGS (WITH THE EXCEPTION OF PRE TENDER QUERIES ONLY).
- THIRD PARTY INFORMATION IS USED TO PREPARE THE ENGINEERING DESIGN (INCLUDING ARCHITECTURAL LAYOUT, GROUND INVESTIGATION, EXISTING UTILITIES RECORDS, AND SPECIALIST DESIGN ITEMS). THE ENGINEERING DESIGN MUST THEREFORE BE READ IN CONJUNCTION WITH ALL THIRD PARTY INFORMATION PRIOR TO COMMENCING WORK. QUEENSBERRY DESIGN LTD ARE NOT RESPONSIBLE FOR ANY THIRD PARTY INFORMATION OR DETAILS.
- HOUSE TYPE WORKING DRAWINGS ARE TO BE USED IN CONJUNCTION WITH THE PLOT SETTING OUT DRAWING.
- DRAWING STATUS WILL REMAIN PRELIMINARY UNTIL FULL TECHNICAL APPROVAL IS RECEIVED FROM LOCAL AUTHORITY AND SEWERAGE UNDERTAKER. WORKS COMMENCED PRIOR TO TECHNICAL APPROVAL ARE DONE SO AT RISK AND MAY BE SUBJECT TO CHANGE.
- THE CONTRACTOR IS EXPECTED TO PREPARE APPROPRIATE CONSTRUCTION METHOD STATEMENTS FOR ALL ASPECTS OF APPOINTED WORK. THIS SHOULD INCLUDE ANY TEMPORARY PROTECTION WORKS.
- LAND DRAINAGE IS NOT PERMITTED TO DISCHARGE INTO THE PUBLIC SEWER NETWORK ANY NEED FOR LAND DRAINAGE SHOULD BE ASSESSED BY THE GROUND WORKER AND LANDSCAPER DURING CONSTRUCTION AND PLACEMENT OF GARDENS ON AN INDIVIDUAL PLOT BASIS. IF LAND DRAINAGE DESIGNS ARE REQUIRED, THEY SHOULD BE APPOINTED PRIOR TO PLOT COMPLETION.
- THE CONTRACTOR IS EXPECTED TO CROSS CHECK ALL DRAINAGE INVERTS PRIOR TO COMMENCING WORK. THIS MAY INVOLVE COMPLETION OF TRIAL HOLES IF INVERT LEVELS HAVE BEEN INTERPOLATED.
- THE CONTRACTOR MUST MONITOR THE 'AS BUILT' PROGRESS OF EACH CONSTRUCTION STAGE (ROADS/SEWERS/PILOT WORKS/ ETC.) TO ENABLE THE NEXT STAGES OF CONSTRUCTION TO BE CHECKED BEFORE INSTALLATION. FOR THIS REASON THE DESIGN OF FLOOR LEVELS, EXTERNAL WORKS, RETAINING WALLS, AND PLOT DRAINAGE ARE TO BE READ AS GUIDANCE ONLY.

- ALL HIGHWAY WORKS TO BE CARRIED OUT IN ACCORDANCE WITH THE CURRENT LOCAL AUTHORITY DESIGN GUIDE AND SPECIFICATION
- ALL EXCAVATIONS BELOW PROPOSED AND EXISTING HIGHWAYS TO BE BACK FILLED WITH GRANULAR TYPE 1 SUB-BASE AND WELL COMPACTED IN LAYERS NOT EXCEEDING 150MM UNLESS OTHERWISE AGREED
- HIGHWAY AUTHORITY TO BE NOTIFIED BY THE CONTRACTOR PRIOR TO THE COMMENCEMENT OF WORKS.

ADOPTABLE DRAINAGE

- ALL ADOPTABLE DRAINAGE WORKS TO BE IN ACCORDANCE WITH THE WATER AUTHORITIES PUBLICATION - 'CODE OF ADOPTION' AS WELL AS THE APPROVED DRAWINGS
 - PRECAST CONCRETE MANHOLE RINGS TO COMPLY WITH THE RELEVANT PROVISIONS OF BS EN 124-1 PART 200
 - ALL BRICKWORK TO BE CLASS B ENGINEERING COMPLYING WITH THE RELEVANT PROVISIONS OF BS 3921. CONCRETE BRICKS MAYBE USED IF THEIR SPECIFICATION IS THE SAME AS CLASS B ENGINEERING BRICKS. PLEASE SEEK APPROVAL FROM RELEVANT WATER AUTHORITY BEFORE USING.
 - MANHOLE COVERS AND FRAMES SHALL COMPLY WITH THE RELEVANT PROVISIONS OF BS EN 124 AND BE OF A NON-ROCKING, NON-VENTILATING DESIGN
 - LADDERS THAT ARE REQUIRED IN TYPE A MANHOLES ARE TO COMPLY WITH 'CODE FOR ADOPTION'
 - CONCRETE MUST BE EITHER C20 SULPHATE RESISTANT PORTLAND CEMENT WITH HIGH STRENGTH CONCRETE TOPPING TO THE BENCHING OR C35 ORDINARY PORTLAND CEMENT
 - 150MM CONCRETE SURROUND IS REQUIRED AROUND PIPES WHERE THE DEPTH FROM FINISHED SURFACE TO SOFFIT OF PIPE IS LESS THAN 1200MM. THIS MAY BE REDUCED TO 800MM WITHIN OPEN SPACE.
 - THE LOCATION OF EXISTING DRAINAGE THAT IS WITHIN CLOSE PROXIMITY TO THE PROPOSED SITE WORKS, WHICH IS NOT TO BE DIVERTED, SHOULD BE CONFIRMED BY THE CONTRACTOR AND REPORTED TO THE DEVELOPER TO ENSURE IT CORRESPONDS TO THAT SHOWN ON THE ENGINEERING LAYOUT AND THAT NO PROPOSED WORKS ARE AFFECTED.
 - THE POSITION, LINE AND DIAMETER OF ALL EXISTING DRAINAGE APPARATUS SHOULD BE CONFIRMED ON SITE PRIOR TO THE COMMENCEMENT OF THE WORKS. ANY DISCREPANCIES MUST BE REPORTED TO THE ENGINEER IMMEDIATELY.
 - THE CONNECTION OF FOUL AND SURFACE WATER DRAINAGE TO THE EXISTING PUBLIC SEWER SYSTEM SHALL BE SUBJECT TO THE APPROVAL OF THE LOCAL SEWERAGE UNDERTAKER. THE CONTRACTOR IS EXPECTED TO APPLY FOR RELEVANT PERMITS PRIOR TO COMMENCING THE WORK.
 - ROADS AND SEWERS CONTRACTOR MUST INFORM WATER AUTHORITY PRIOR TO WORKS COMMENCING
- EXISTING SERVICES**
PRIOR TO THE COMMENCEMENT OF ANY WORKS UNDER GROUND MAPPING SURVEYS AND CONSTRAINTS PLAN IS TO BE REFERRED TO ANY DISCREPANCIES ARE TO BE REPORTED TO ENGINEER.
ANY EXISTING SERVICES WHICH MAY BE AFFECTED BY THE PROPOSED WORKS SHOULD BE LOCATED BY MEANS OF A HAND DIG IN CLOSE LIAISON WITH THE STATUTORY SERVICE AUTHORITIES. THE CONTRACTOR SHALL INFORM THE DEVELOPER OF ANY SERVICES THAT MAY AFFECT THE PROPOSED DESIGN. CONTRACTOR TO NOTIFY STATUTORY SERVICE AUTHORITIES PRIOR TO COMMENCEMENT OF WORK.
- AS CONSTRUCTED INFORMATION**
IT IS THE CONTRACTORS RESPONSIBILITY TO PROVIDE THE FOLLOWING AS CONSTRUCTED DRAWINGS TO THE DEVELOPER UPON THE COMPLETION OF THE WORKS COVERED BY THE CONTRACT -
- POSITION AND CO-ORDINATES OF ALL ADOPTABLE MANHOLES
 - INVERT AND COVER LEVELS OF ALL ADOPTABLE MANHOLES
 - NEW GULLY POSITIONS AND CONNECTIONS
 - POSITION AND DEPTH OF SERVICE DUCTS FOR WATER, GAS, ELECTRIC, BT, CABLE AND STREET LIGHTING, STATING SIZE AND NUMBER OF DUCTS.

A	02.08.26	Updated to S104 comments	JP	AL
-	-	-	-	-

Rev.	Date	Revision Details	Drawn	Checked
------	------	------------------	-------	---------

© This drawing is the property of Queensberry Design Limited and the information can only be reproduced with their prior permission.

QUEENSBERRY DESIGN
CIVIL, STRUCTURAL, ARCHITECTURAL & GEOTECHNICAL CONSULTANTS

NORTH EAST OFFICE
5 THE STATHIES, THE WATERMARK,
GATESHEAD, TYNE AND WEAR NE11 8BN
0191 480 8000

NORTH WEST & YORKSHIRE OFFICE
2A ST MARTINS LANE, YORK, YO1 6LN
01904 500662

www.queensberrydesign.co.uk

Client **MILLER HOMES**

Project **SOUTH TYNESIDE COLLEGE**

Title **ADOPTABLE DRAINAGE DETAILS**

Drawn **FA** Checked **-** Date **MARCH 2026**

Drawing Number **QD2438-08-01**

Drawing Status **PRELIMINARY** Scale **1:25 - A1** Rev. **A**